
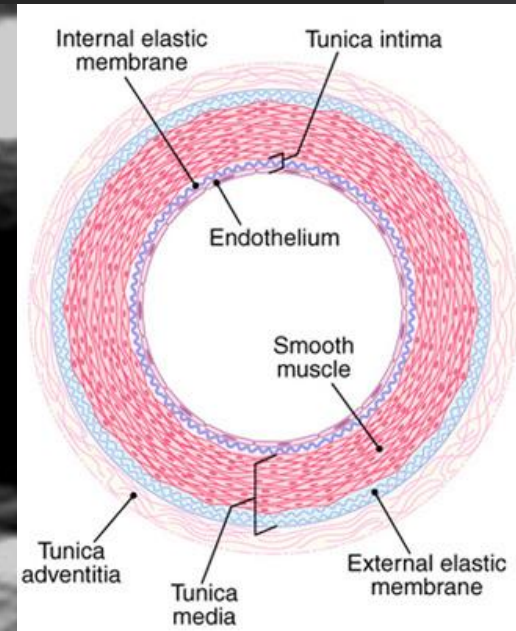




Where is the Carotid Plaque? A Training Tool for GP's

training images by Michel Romanens /
August 2016

Pathological Anatomy

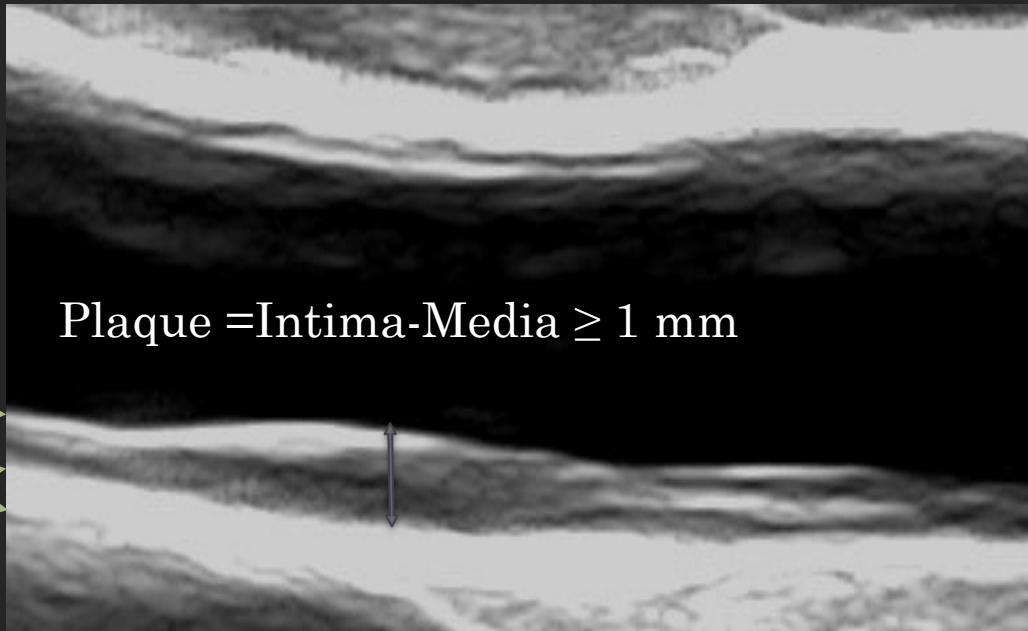


Pathological Anatomy

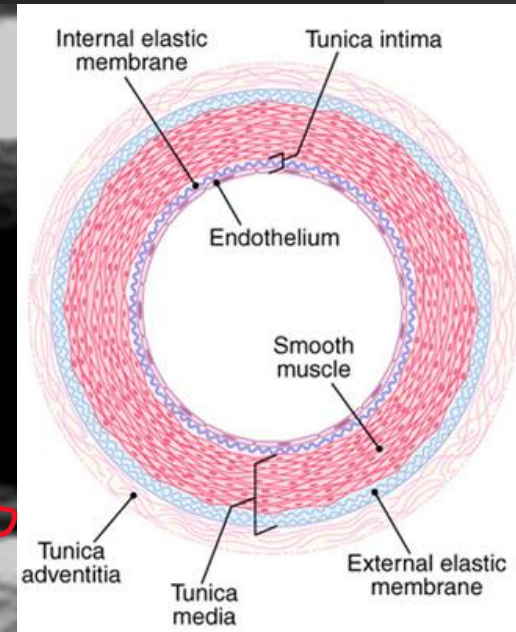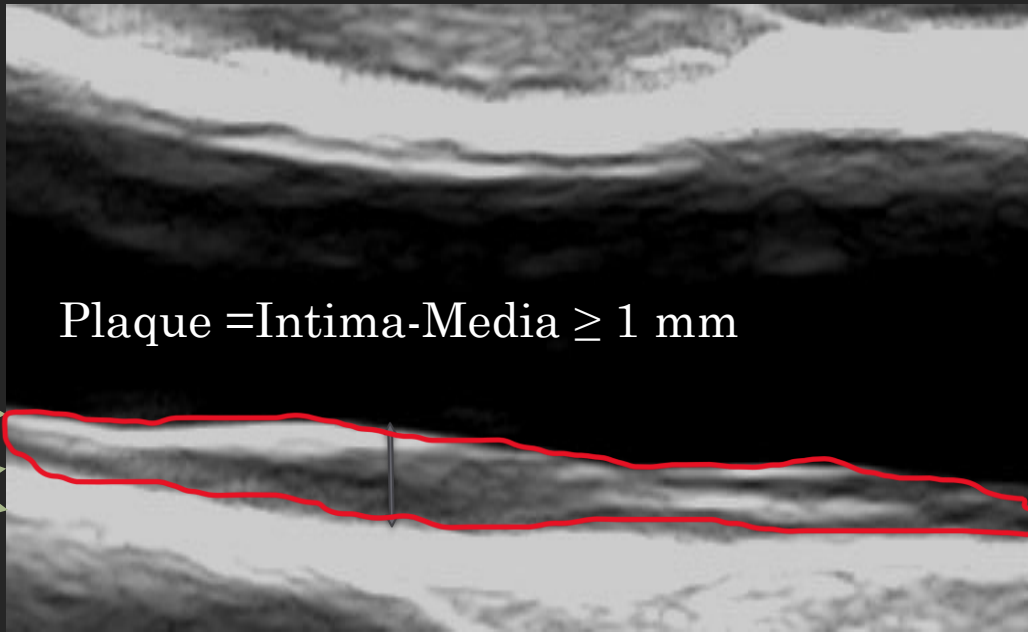

Examples



Examples

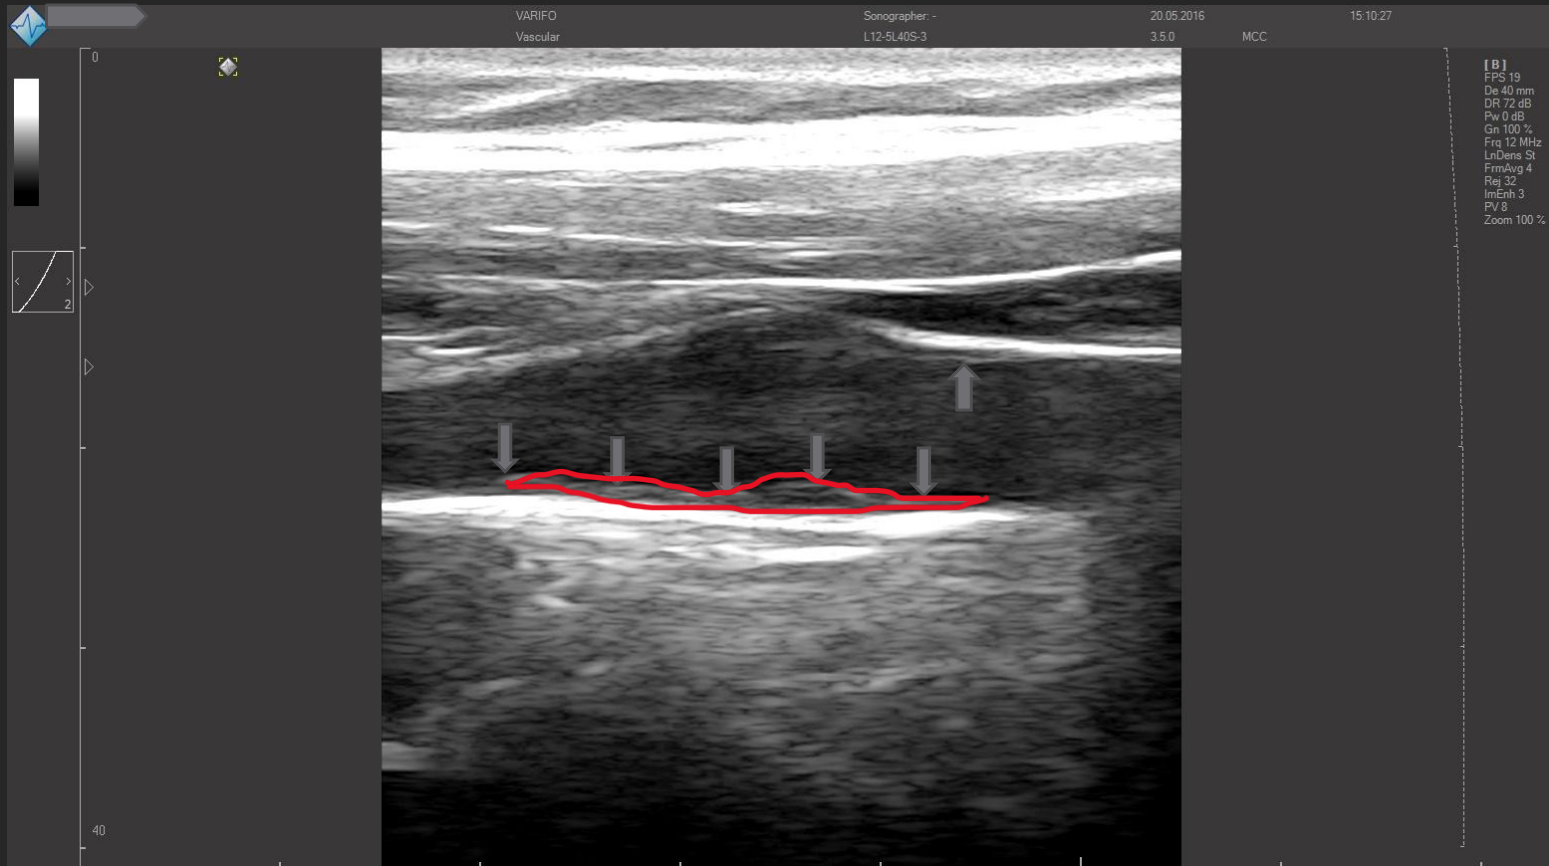



VARIFO
Vascular


Sonographer: -
L12-5L40S-3

25.05.2016
3.5.0

08:25:40

MCC

0
40

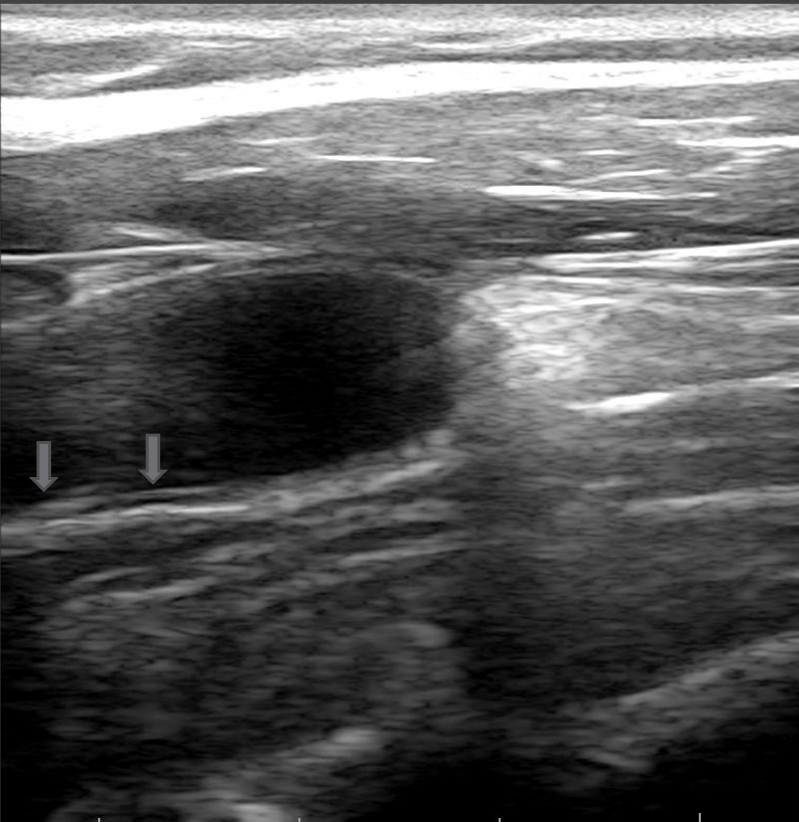

[B]
FPS 20
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Reg 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


25.05.2016
3.5.0

08:25:40

MCC

0

40

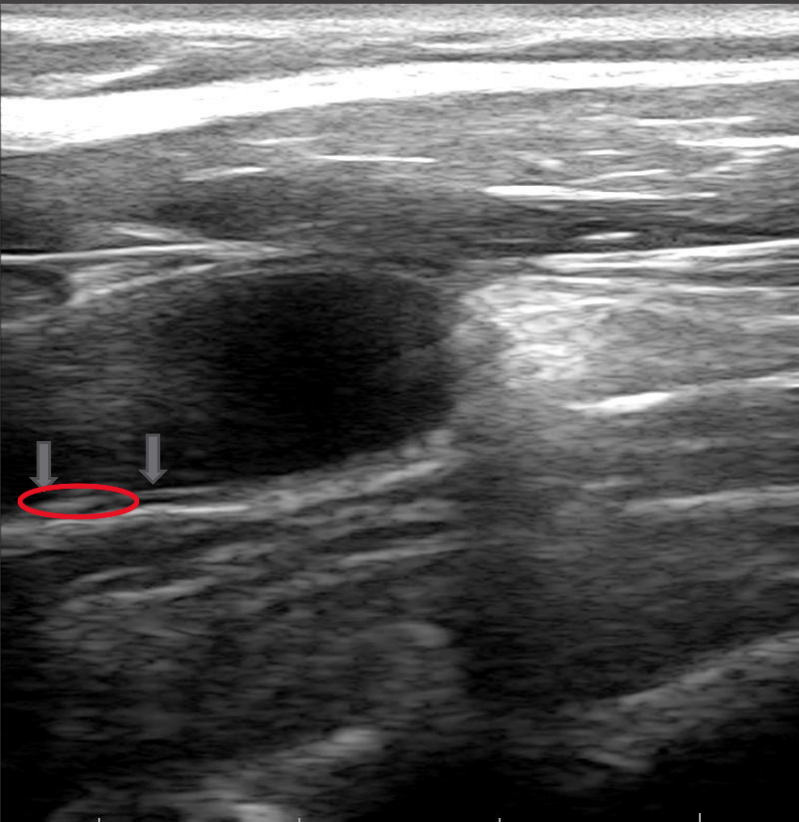

[B]
FPS 20
De 40 mm
DR 72 dB
Pwr 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Reg 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular


Sonographer: -
L12-5L40S-3

04.05.2016
3.5.0

15.42.25

MCC

0
40

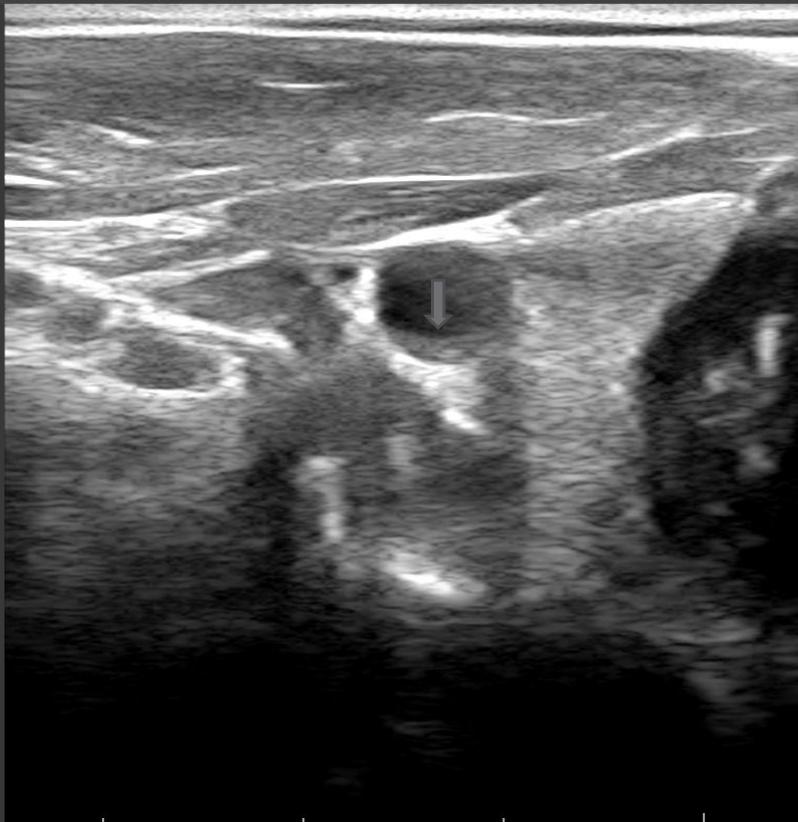

[B]
FPS 19
De 40 mm
DR 72 dB
Pwr 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



ES



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

24.05.2016
3.5.0

08:14:31

MCC

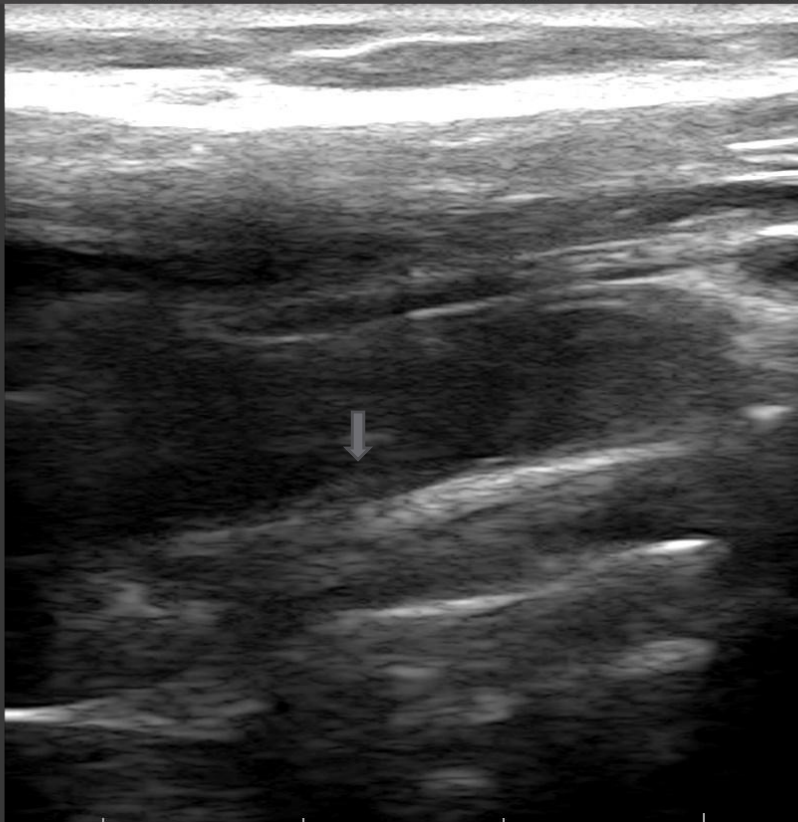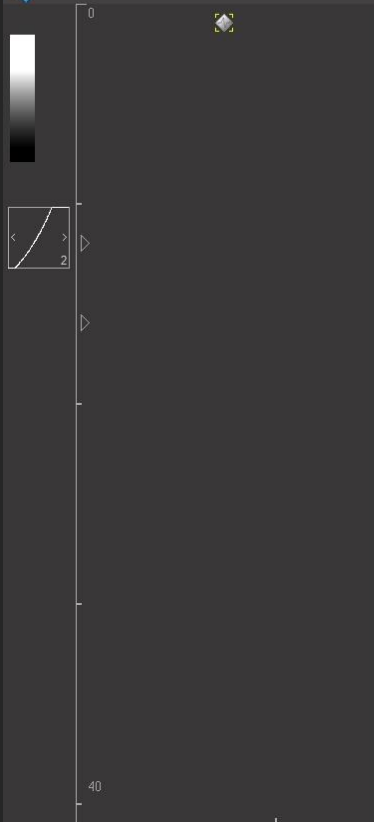

[B]
FPS 20
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



EPPE

VARIFO
Vascular

Sonographer: -
L12-5L40S-3

04.05.2016
3.5.0


14:05:39

MCC

0

2

40

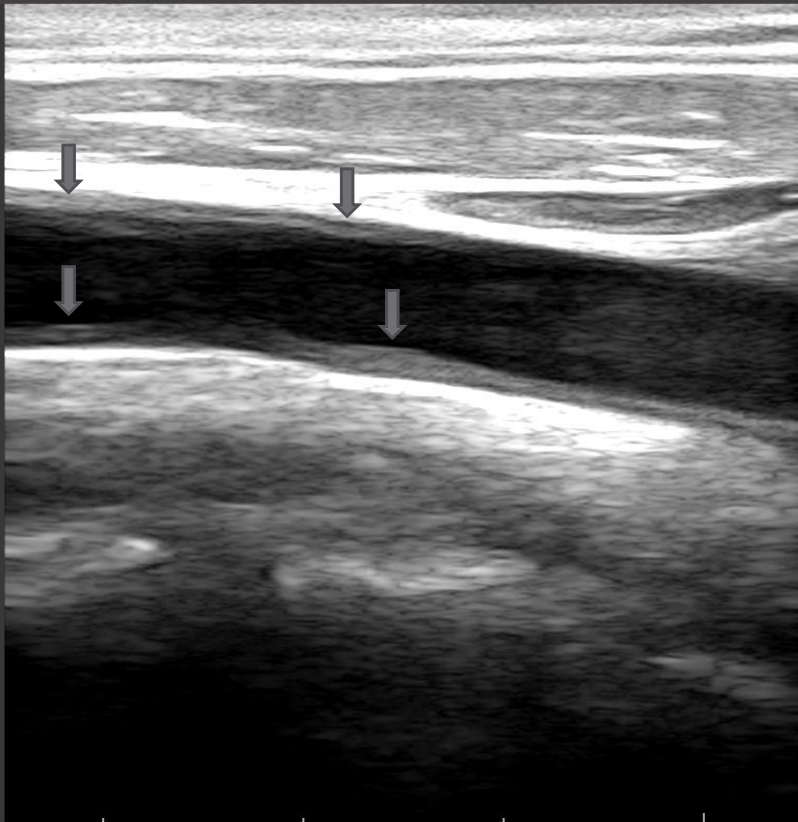

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



EPPE


VARIFO
Vascular

Sonographer: -
L12-5L40S-3

04.05.2016
3.5.0

14:05:39

MCC

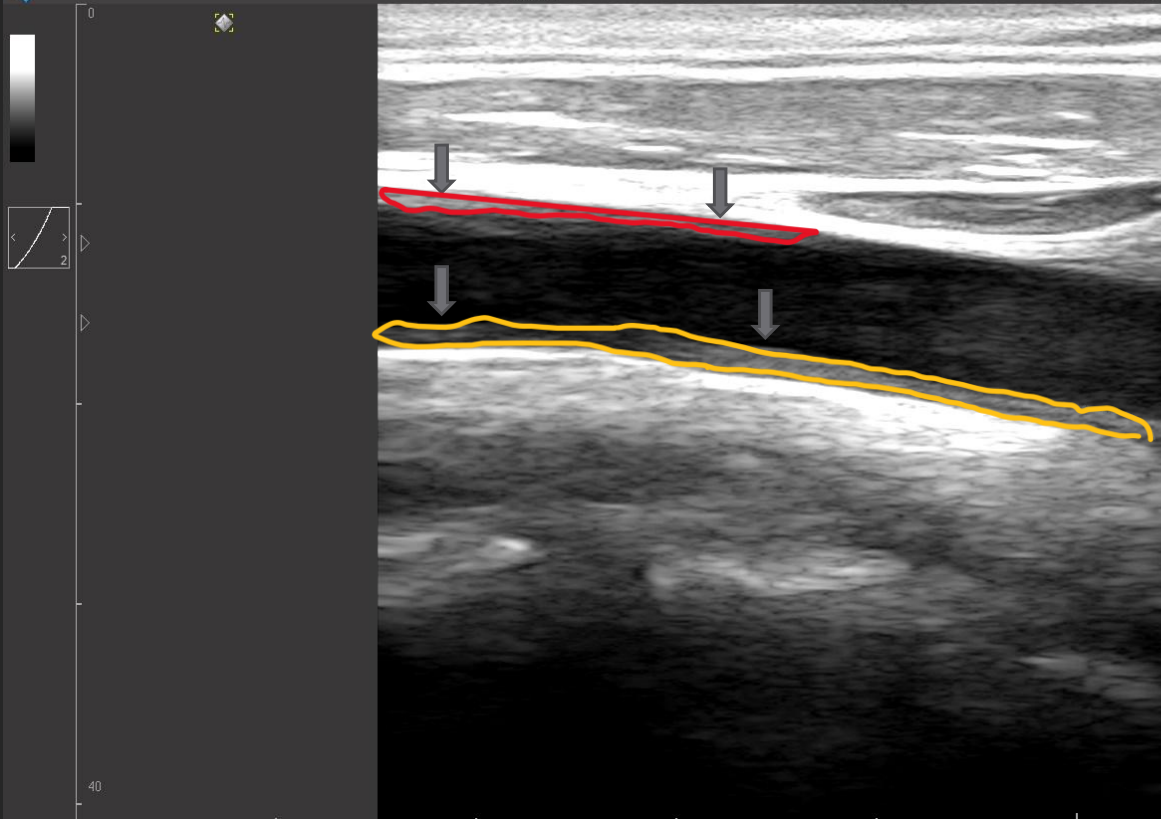

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %




VARIFO
Vascular

Sonographer: -
L12-5L40S-3

30.05.2016
3.5.0

13:34:00

MCC

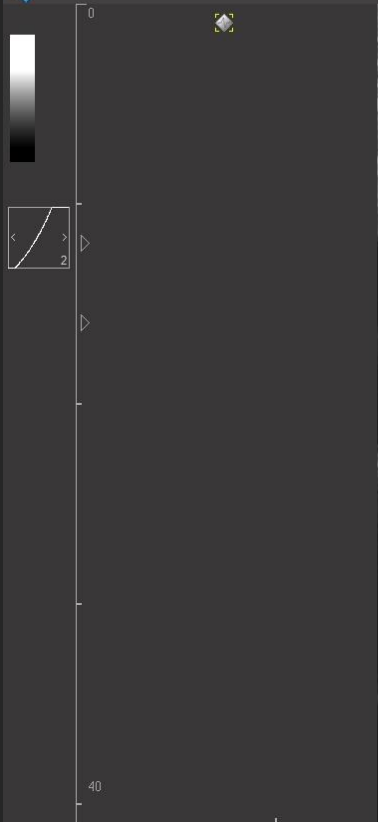

[B]
FPS 19
De 40 mm
DR 72 dB
Pwr 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

30.05.2016
3.5.0


MCC

13:34:00

0

2

40

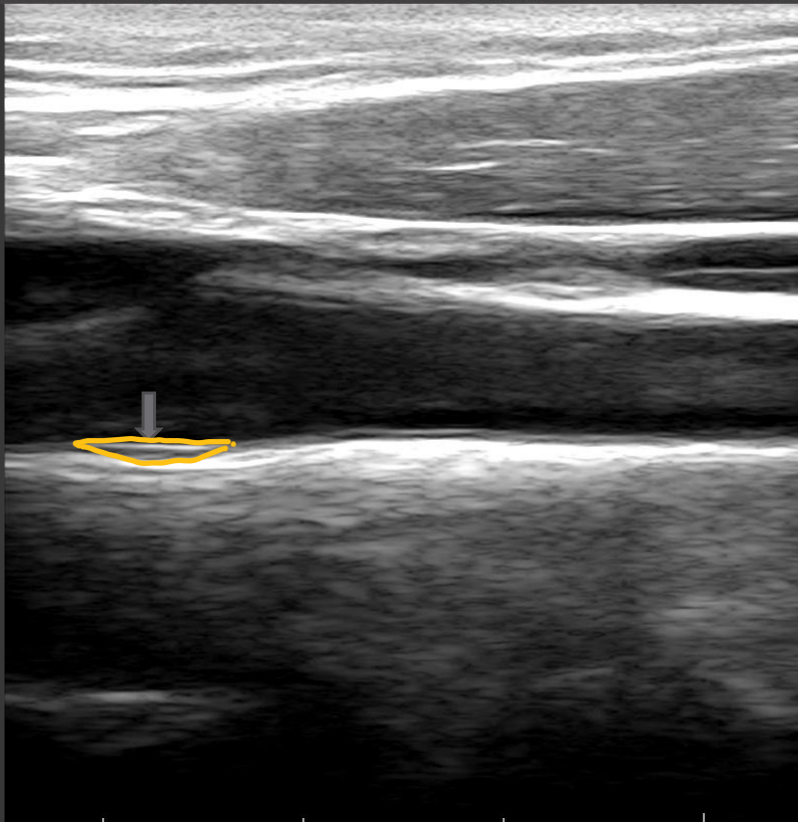

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



A



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

30.05.2016
3.5.0

10.17.39

MCC

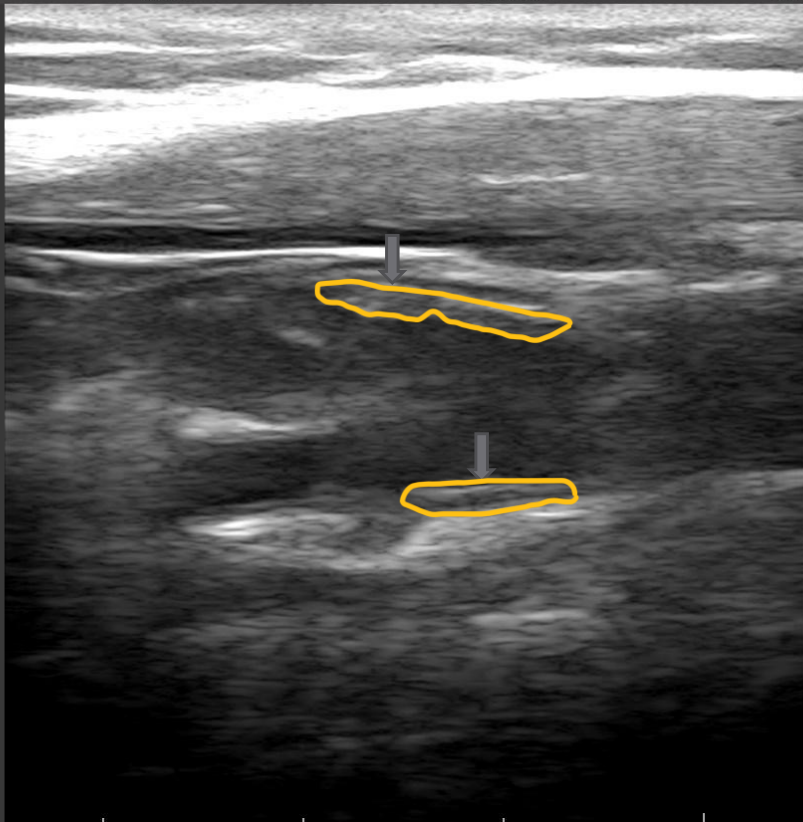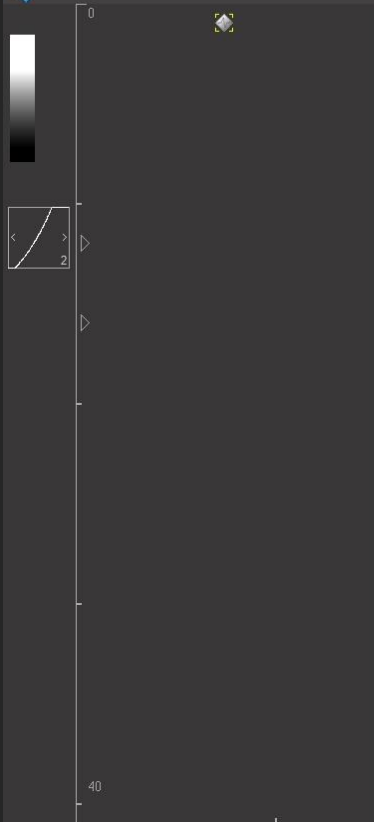

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



29.02.1944

VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

13.26.22

MCC

0

2

40



[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Reg 32
ImEnh 3
PV 8
Zoom 100 %



29.02.1944


VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

MCC

13.26.22

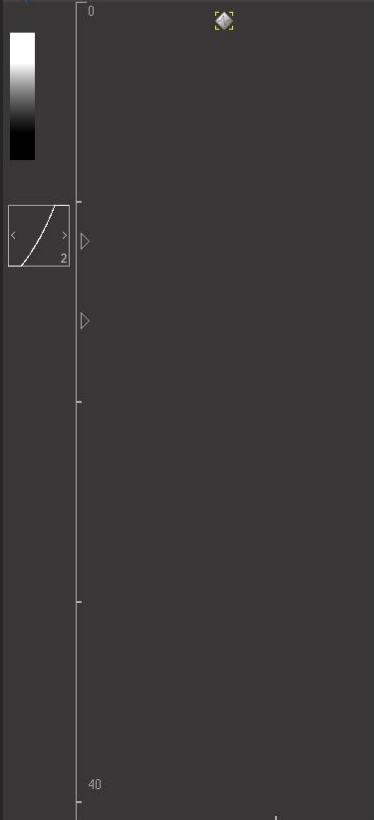

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Reg 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


04.05.2016
3.5.0

15:41:49

MCC

0

40

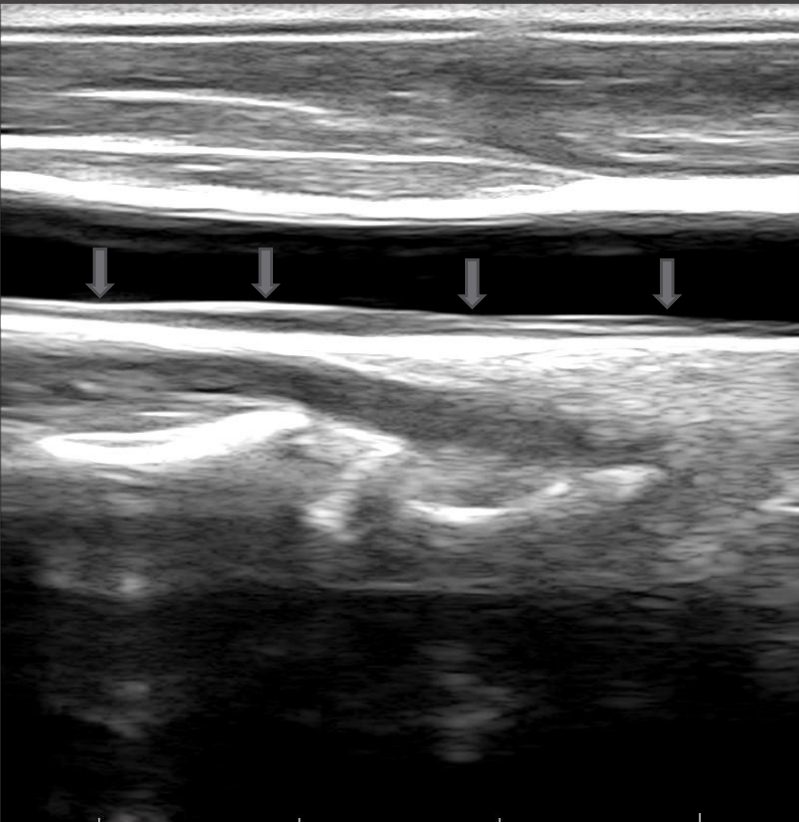

[B]
FPS 19
De 40 mm
DR 72 dB
Pw0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular


Sonographer: -
L12-5L40S-3

04.05.2016
3.5.0

15:41:49

MCC

0
40

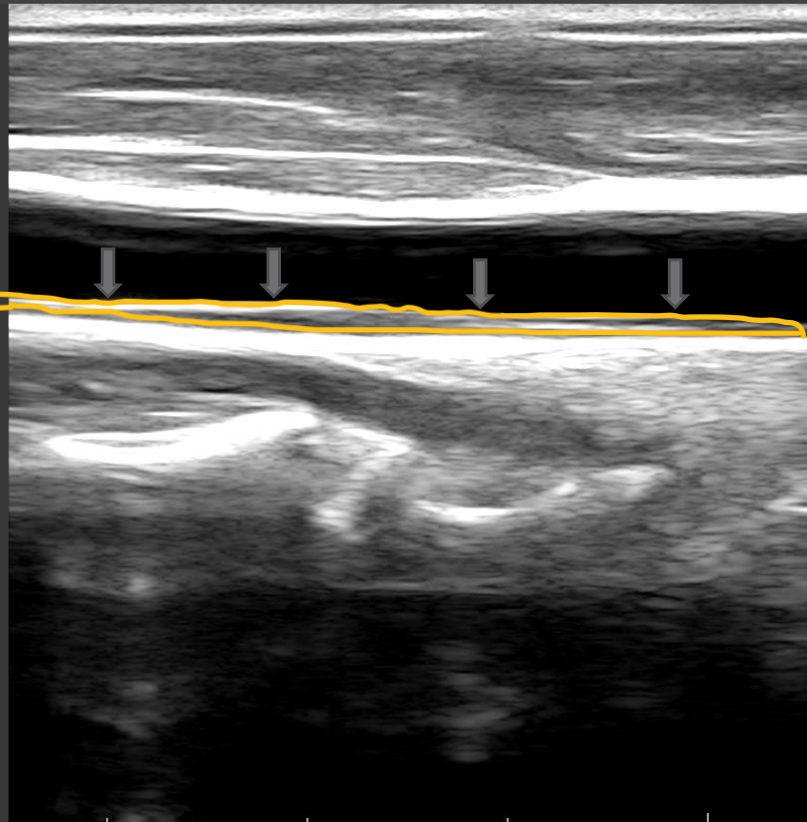

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

18.05.2016
3.5.0

13.17.56

MCC

0

< > 2

>

40



[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


18.05.2016
3.5.0

13.17.56

MCC

0

40

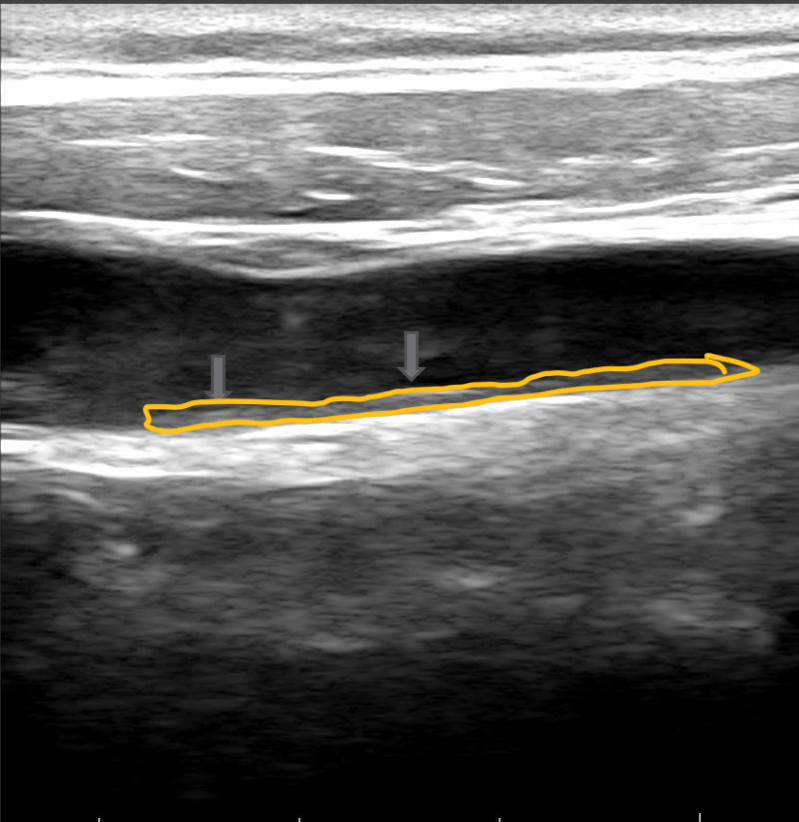

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular


Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

14:17:04

MCC

0
40

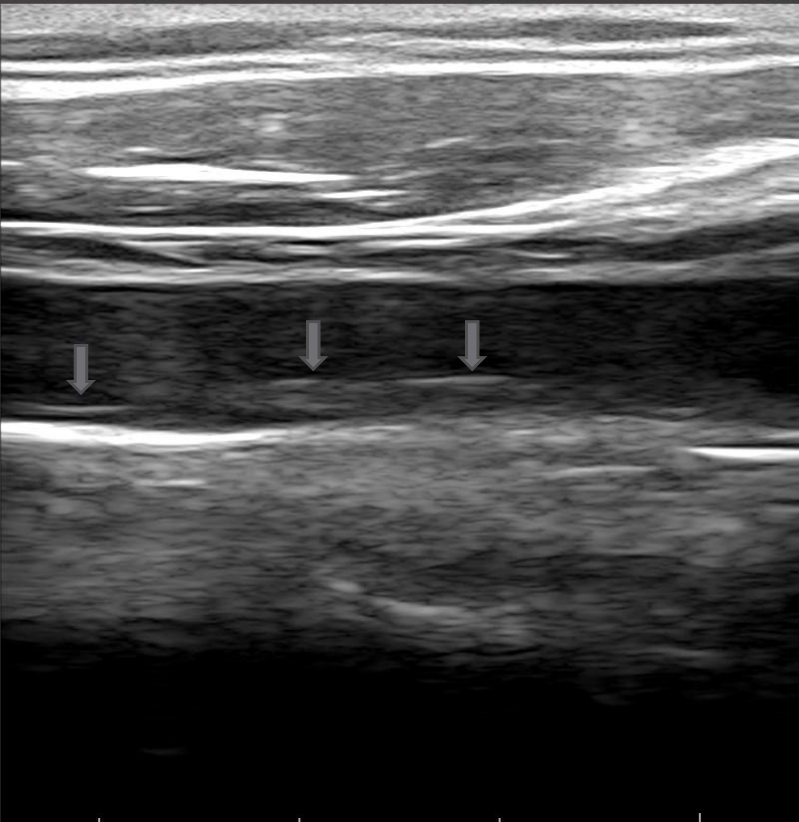

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %




VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

MCC

14:17:04

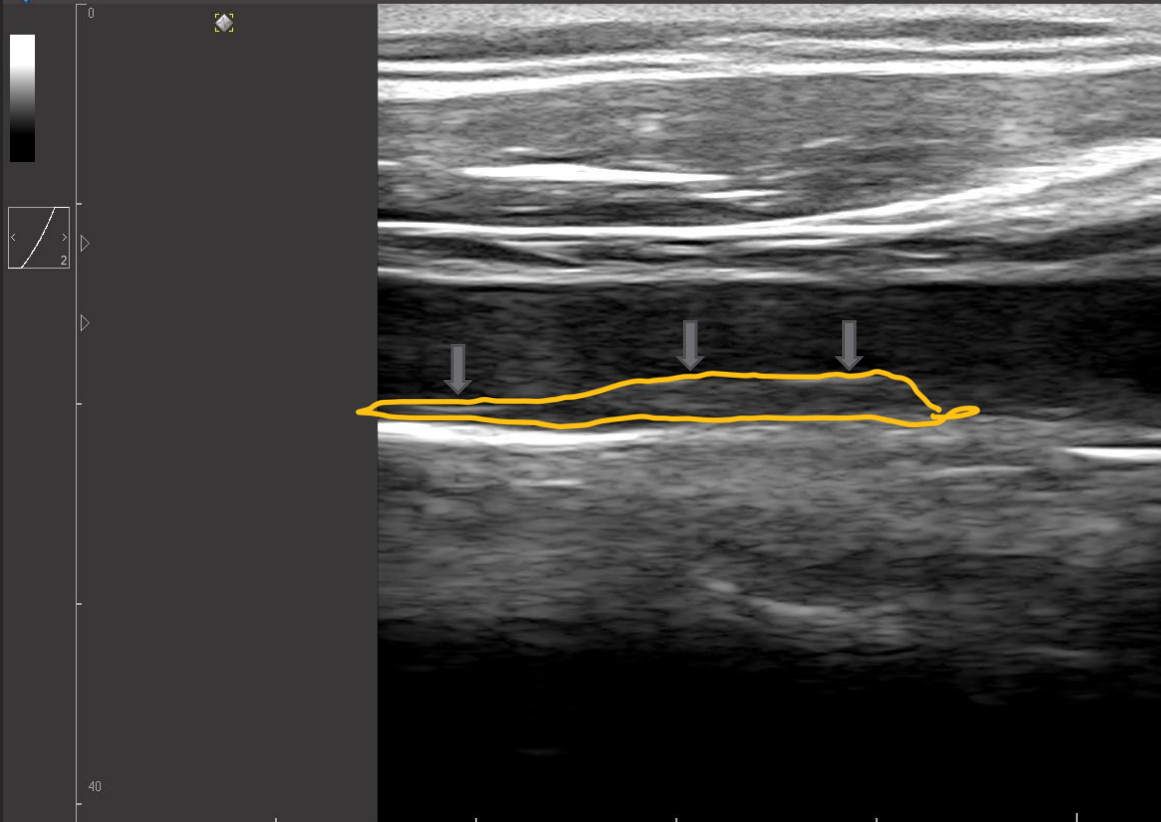

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular


Sonographer: -
L12-5L40S-3

24.05.2016
3.5.0

MCC

09:53:11

0
40

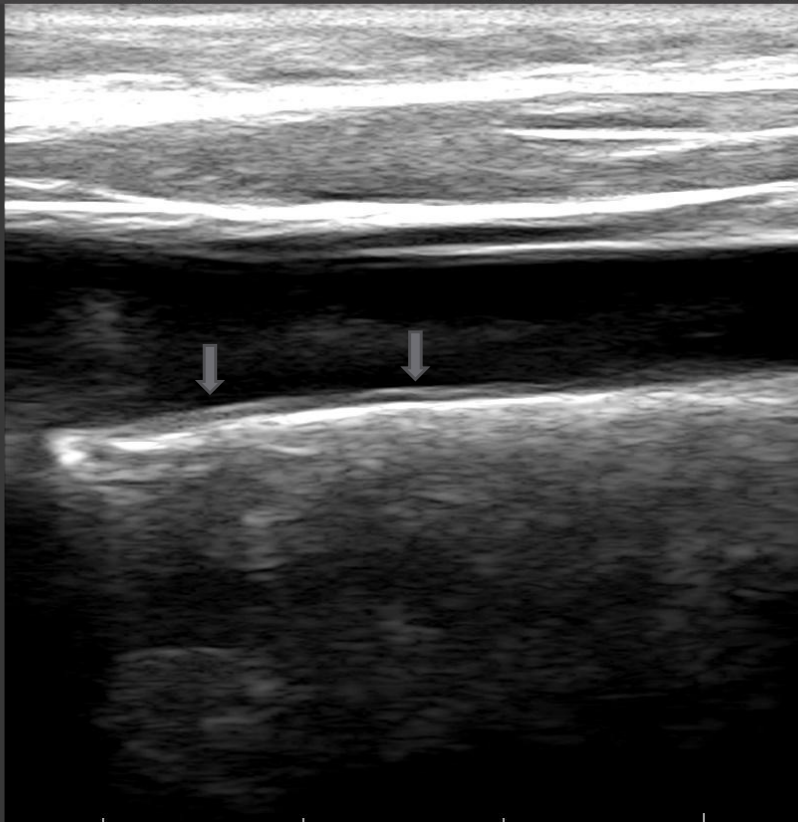

[B]
FPS 18
De 40 mm
DR 72 dB
Pw0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

24.05.2016
3.5.0

MCC


09:53:11

0

< > 2

>

40

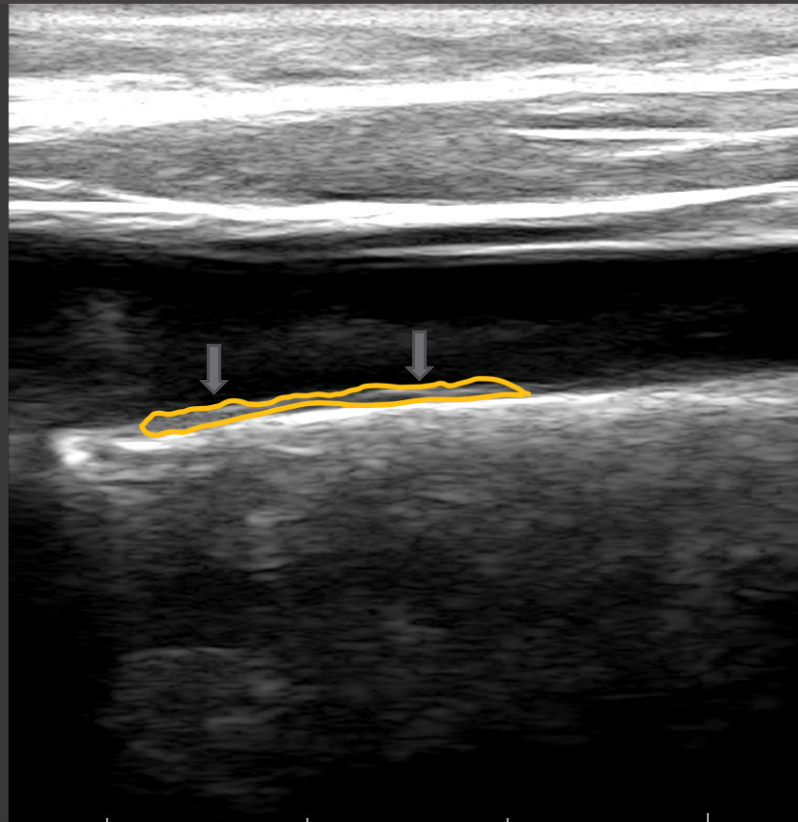

[B]
FPS 18
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

25.05.2016
3.5.0

10.11.49

MCC

0

40



[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


25.05.2016
3.5.0

10.11.49

MCC

0

40

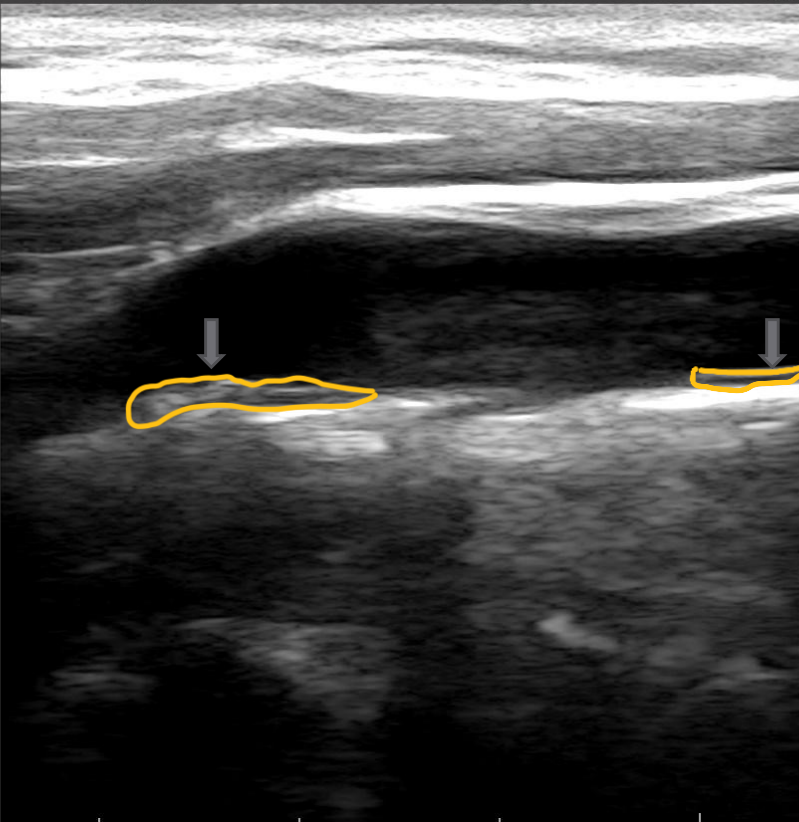

[B]
FPS 19
De 40 mm
DR 72 dB
Pw0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

23.05.2016
3.5.0

09:15:11

MCC

0

2

40



[B]
FPS 20
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

23.05.2016
3.5.0

MCC

09:15:11

0

< > 2

>

40



[B]
FPS 20
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

30.05.2016
3.5.0


10:17:39

MCC

0

2

40

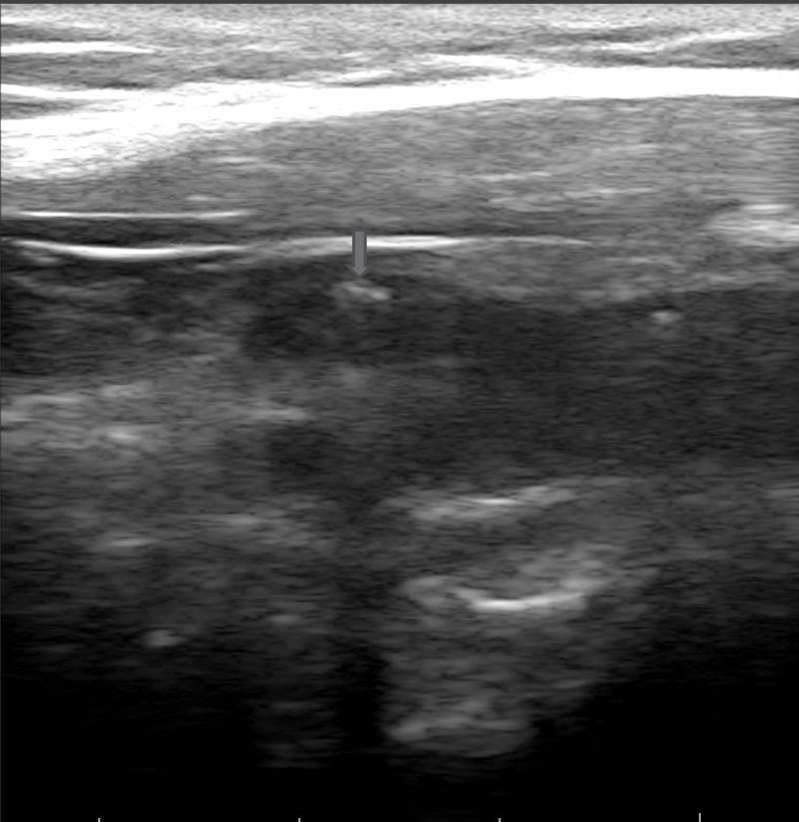

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


11.05.2016
3.5.0

14:09:53

MCC

0

40

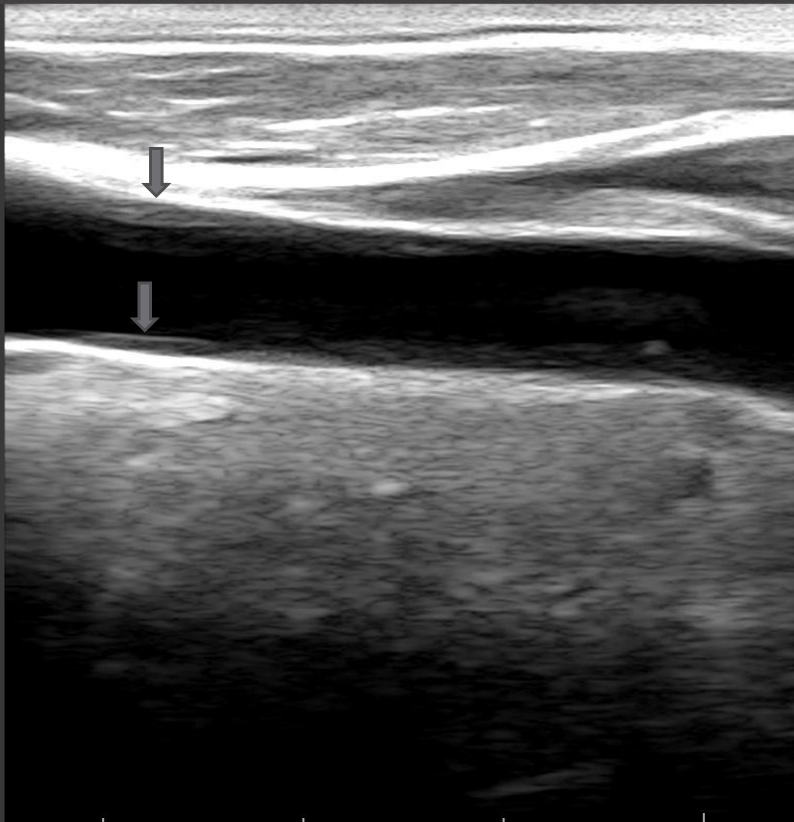

[B]
FPS 19
De 40 mm
DR 72 dB
Pw0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



18.03.1965



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

MCC

14:12:29

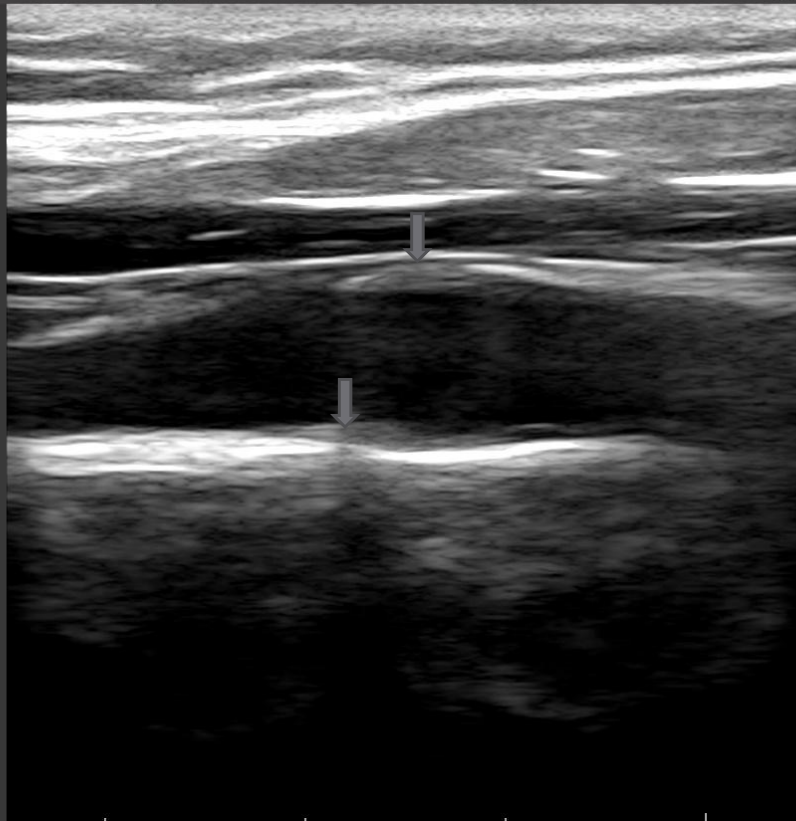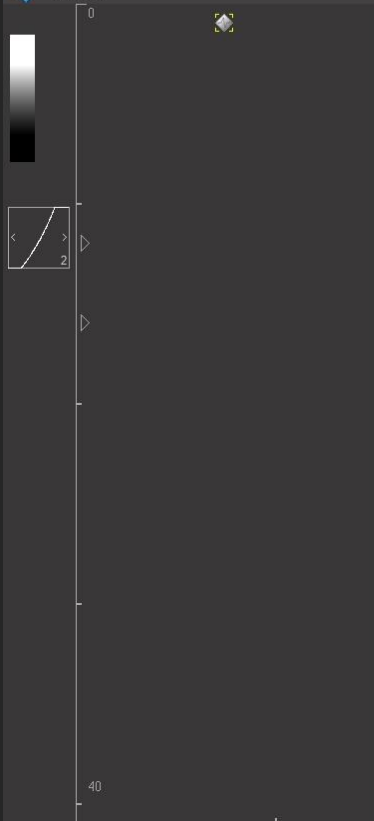

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



18.03.1965



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

MCC

14:12:29

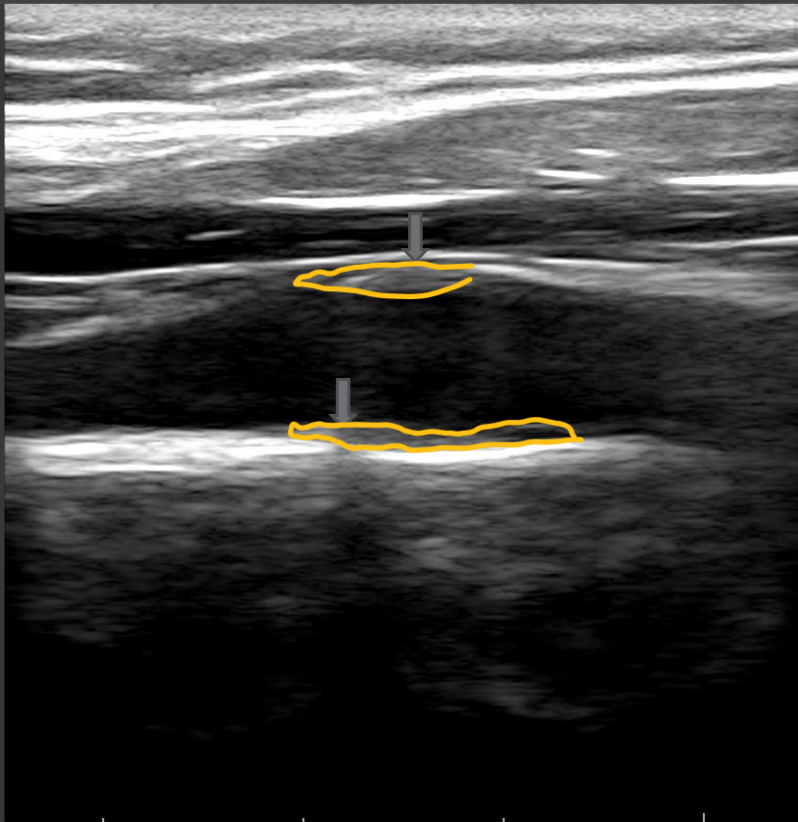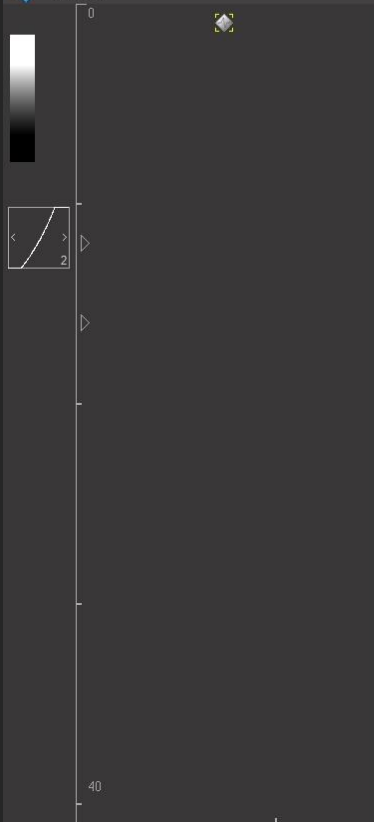

[B]
FPS 19
De 40 mm
DR 72 dB
Pwr 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

23.05.2016
3.5.0


14:17:41

MCC

0

< >
2

40

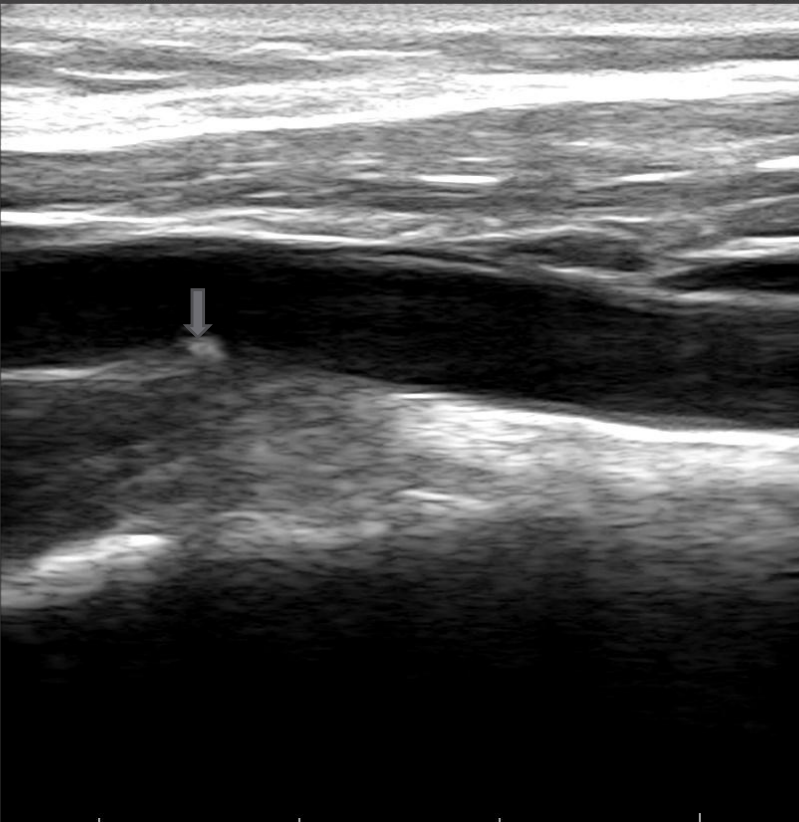

[B]
FPS 19
De 40 mm
DR 72 dB
Pw0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

23.05.2016
3.5.0

14:17:41

MCC

0

40



[B]
FPS 19
De 40 mm
DR 72 dB
Pwr 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


24.05.2016
3.5.0

MCC

08:13:40

0

40

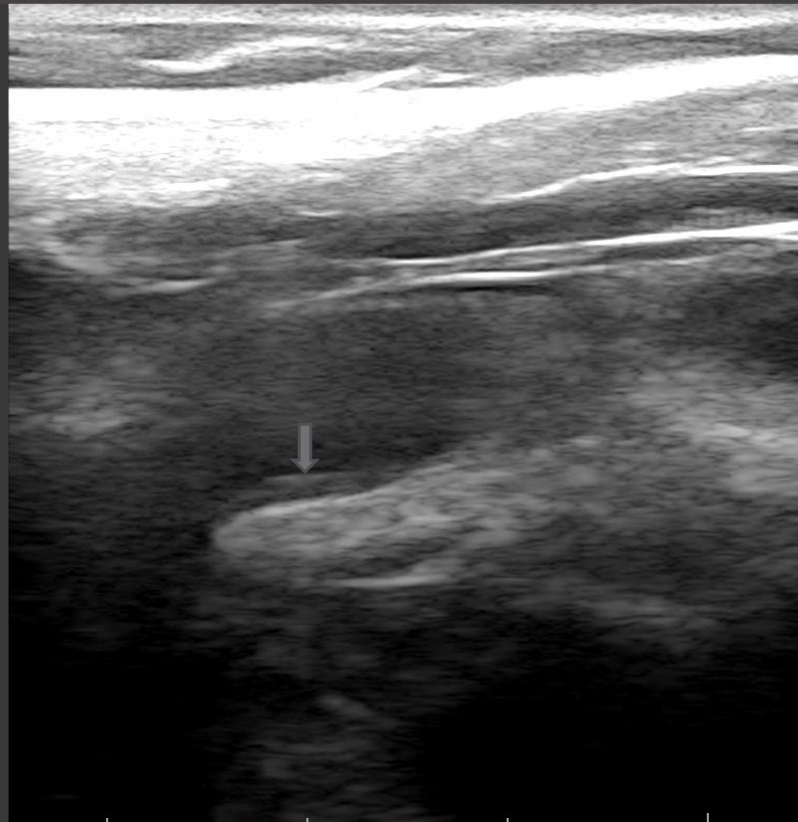

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


24.05.2016
3.5.0

MCC

08:13:40

0

40

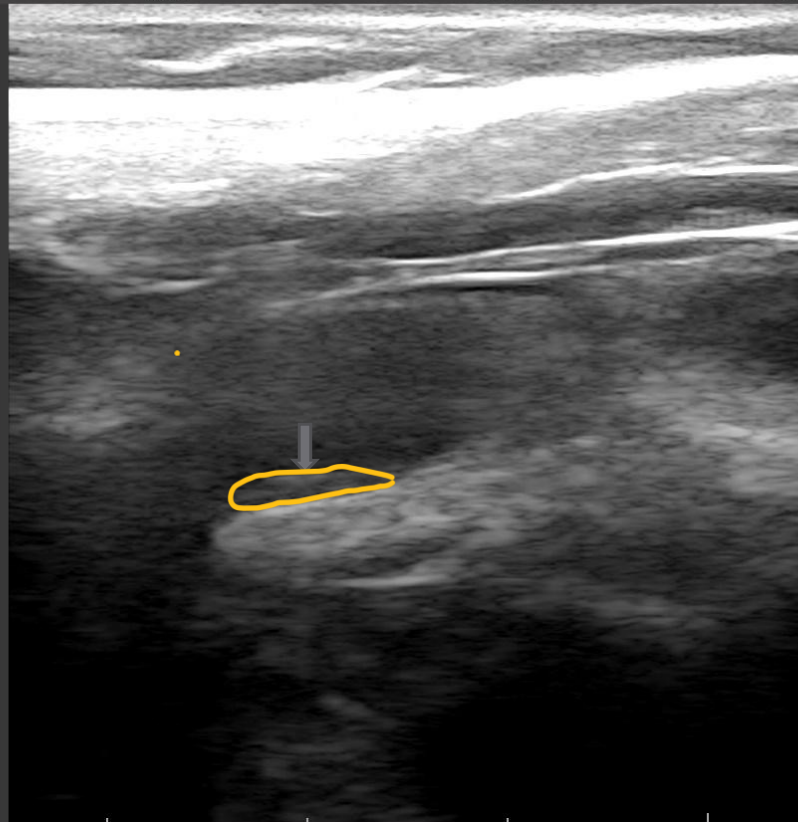

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


30.05.2016
3.5.0

13:34:29

MCC

0

40

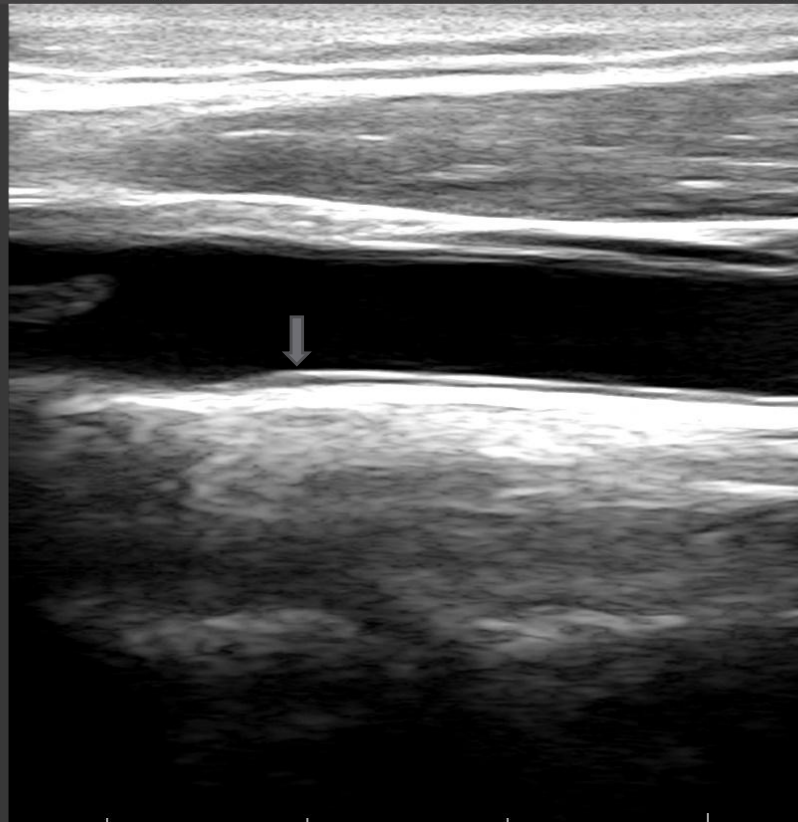

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


01.06.2016
3.5.0

08:24:15

MCC

0

40

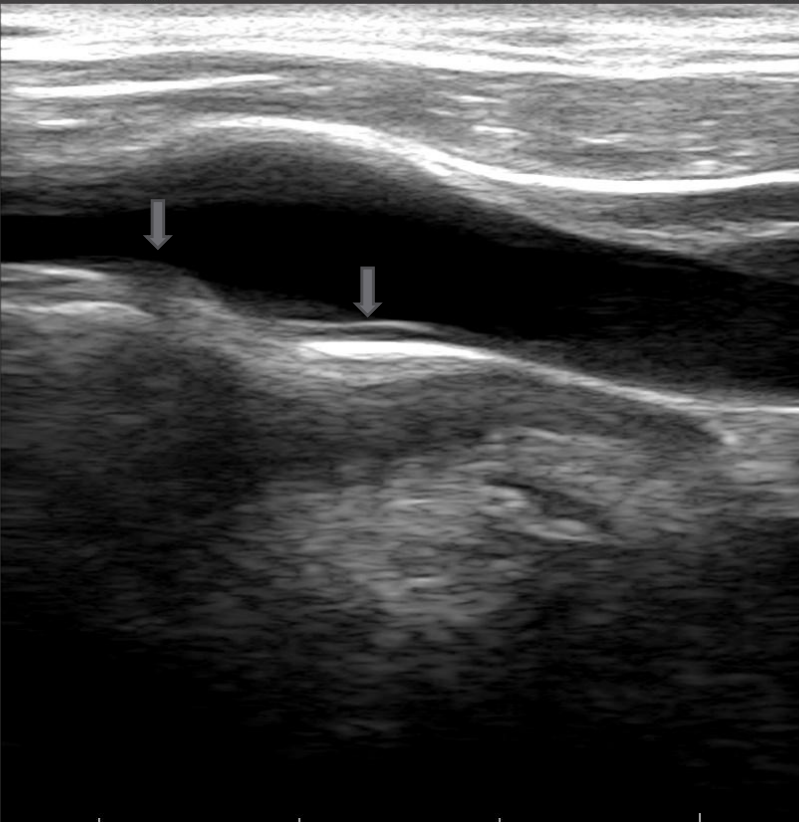

[B]
FPS 18
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

04.05.2016
3.5.0


15.40.46

MCC

0

2

40

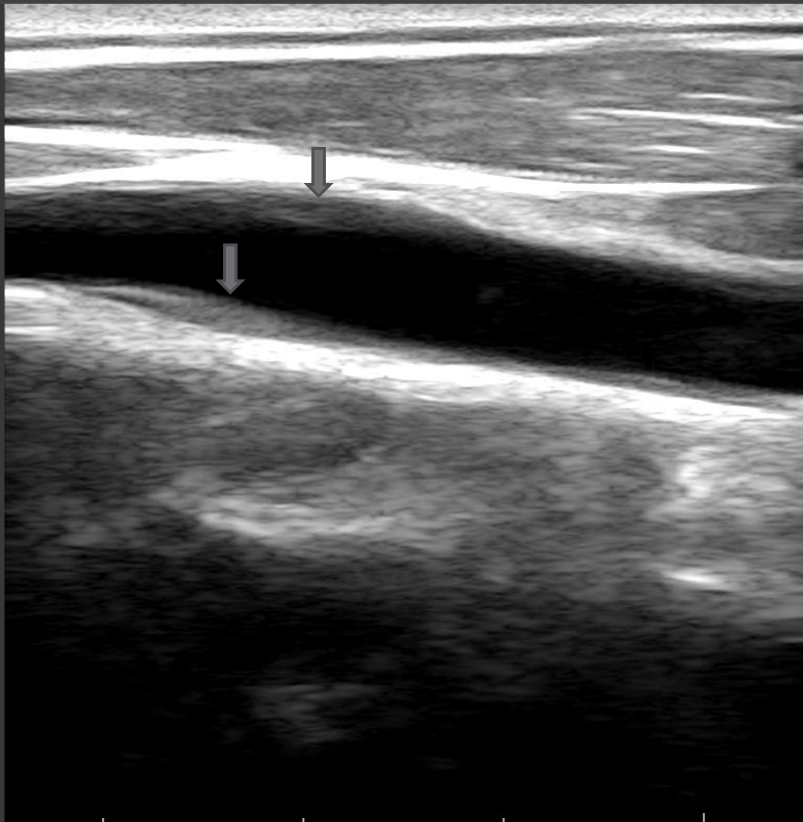

[B]
FPS 19
De 40 mm
DR 72 dB
Pwr 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



18.03.1965



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

MCC

14:11:29

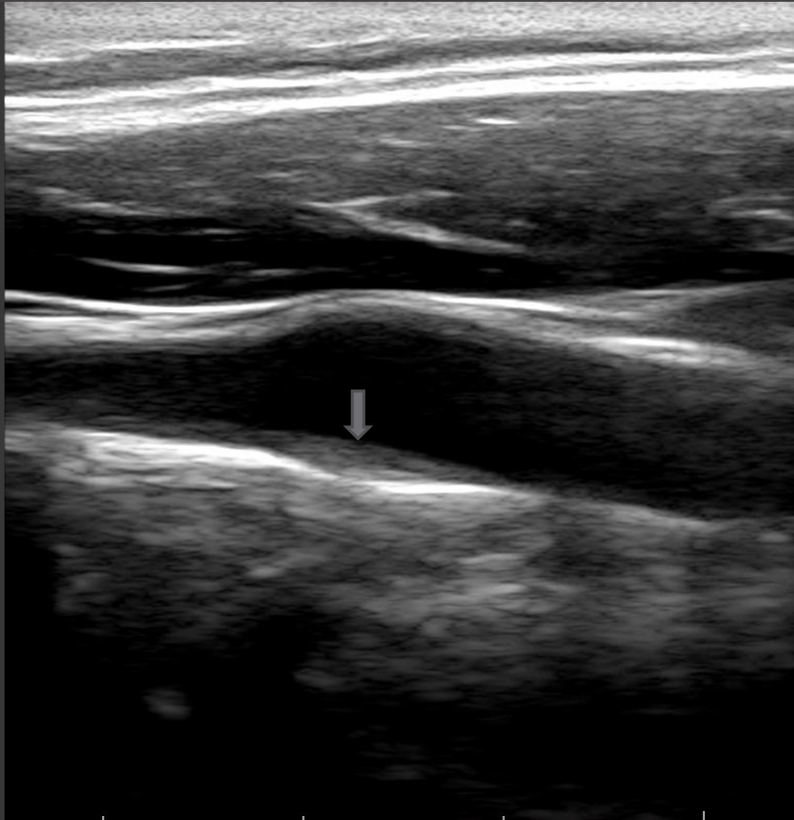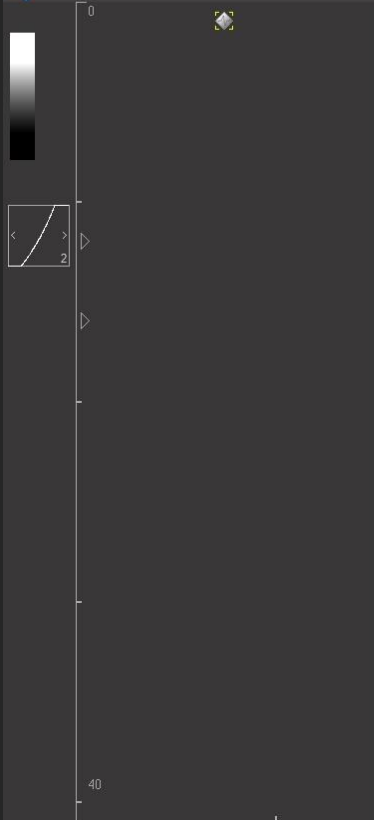

[B]
FPS 19
De 40 mm
DR 72 dB
Pw0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Reg 32
ImEnh 3
PV 8
Zoom 100 %



29.02.1944


VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

MCC

13.25.09

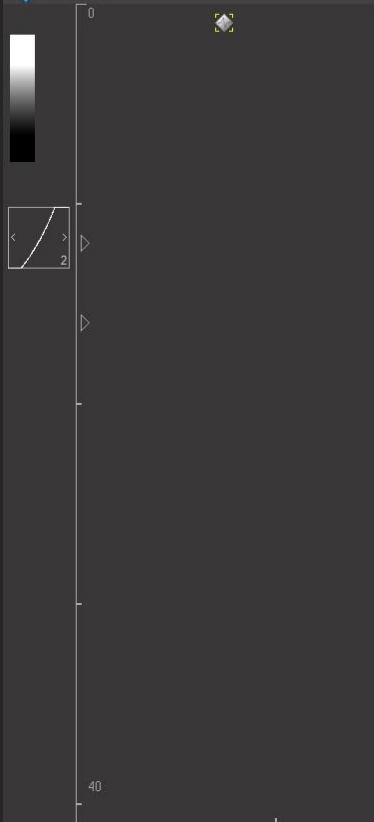

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



29.02.1944



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

MCC

13.25.09

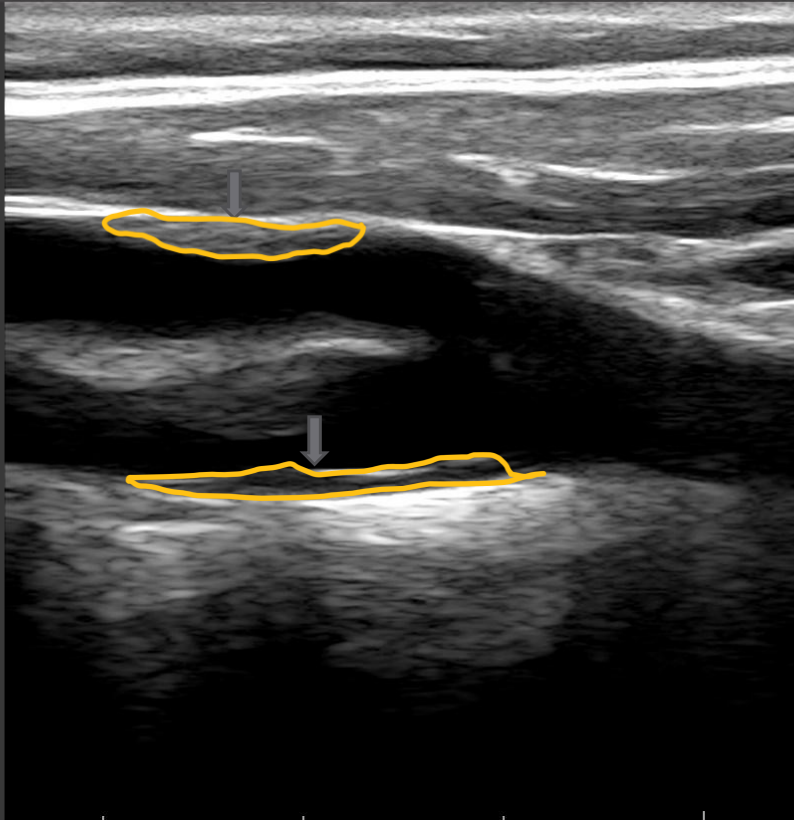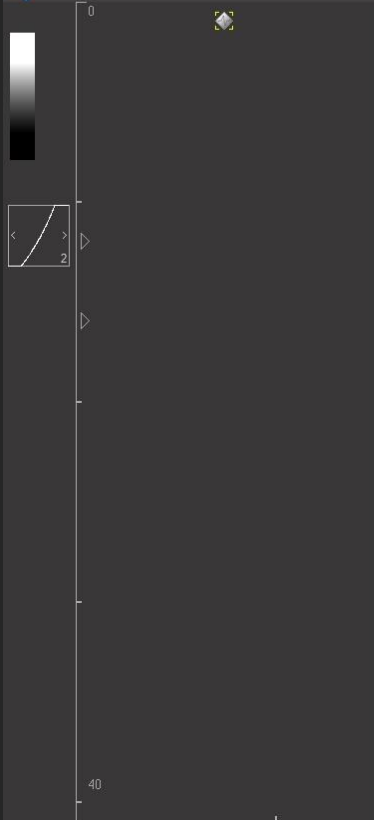

[B]
FPS 19
De 40 mm
DR 72 dB
Pw0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



18.05.1954



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

10.16.20

MCC

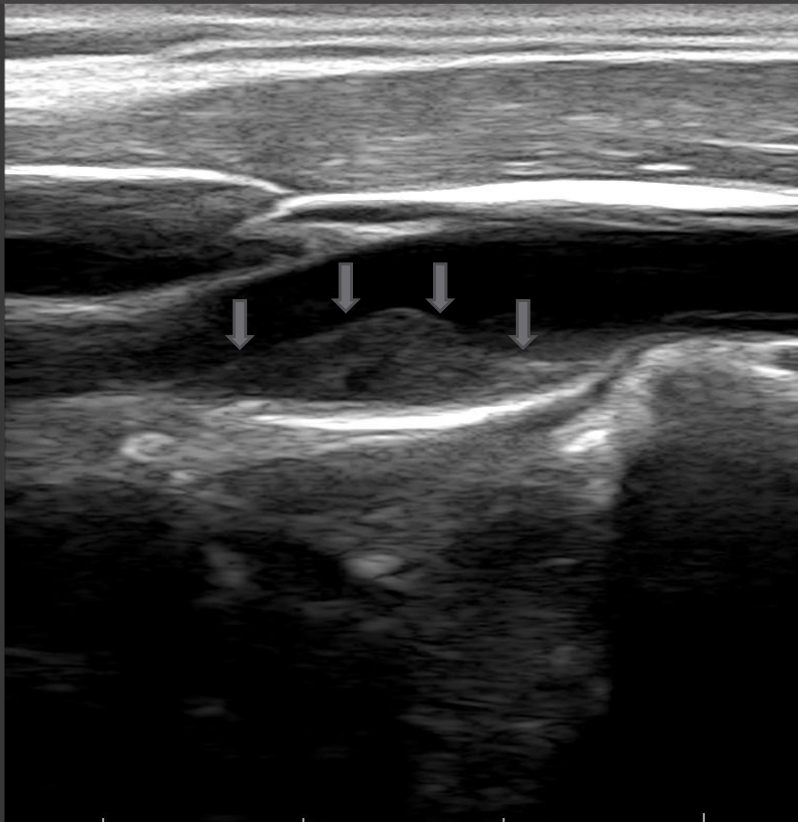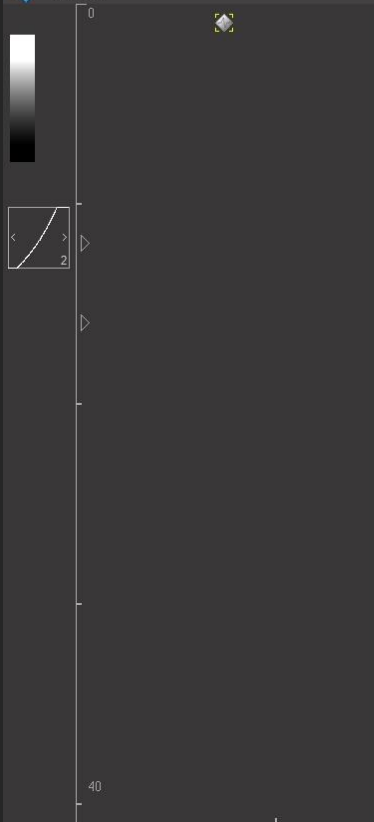

[B]
FPS 18
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



18.05.1954

VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0


MCC

10.16.20

0

2

40

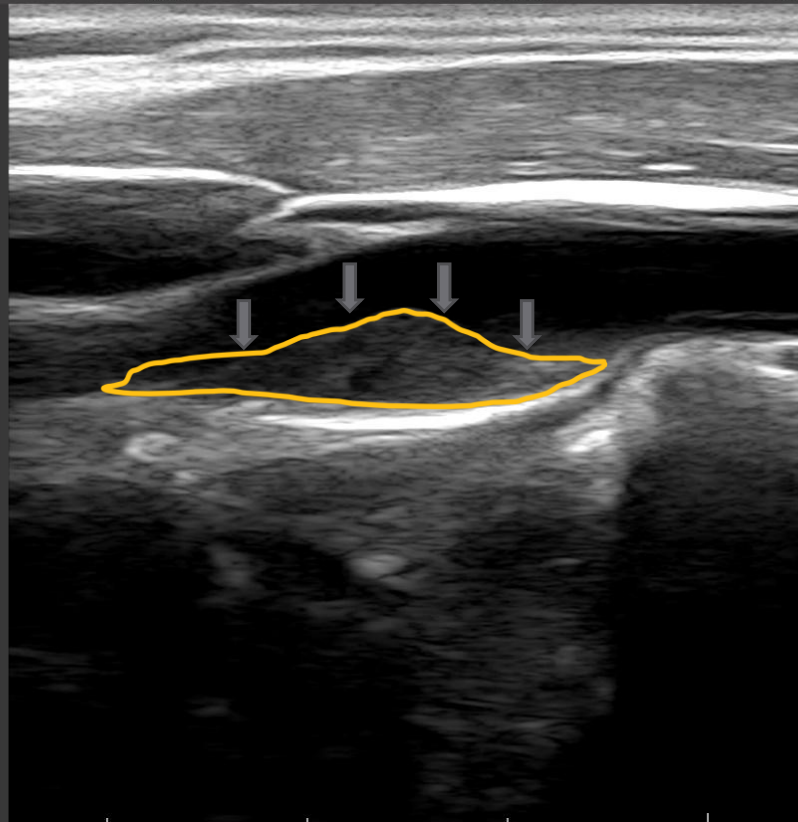

[B]
FPS 18
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


04.05.2016
3.5.0

14:05:15

MCC

0

40

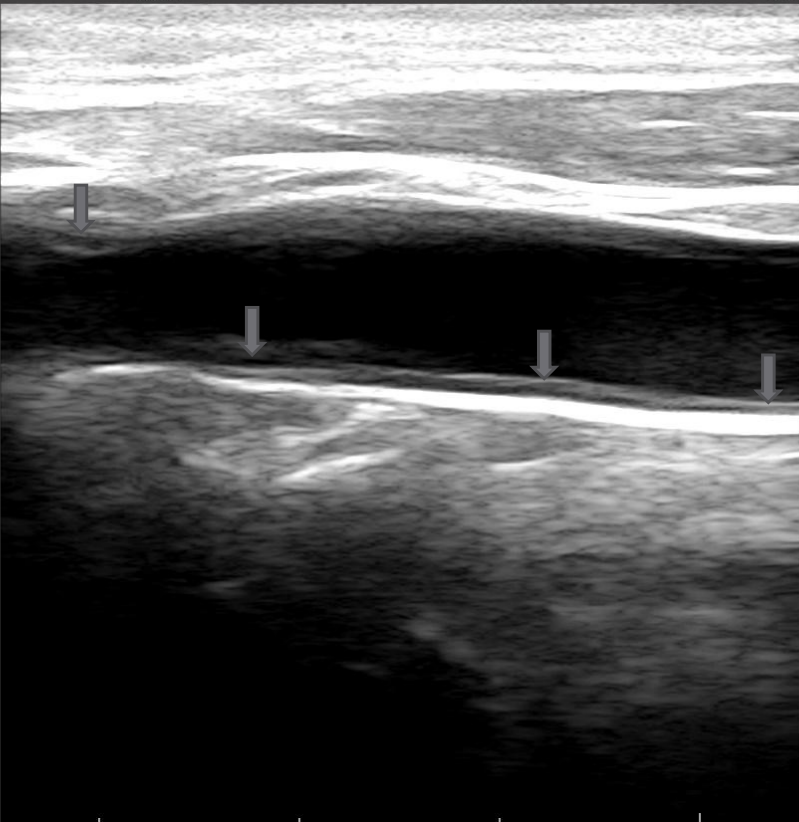

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


04.05.2016
3.5.0

MCC

14:05:15

0

40

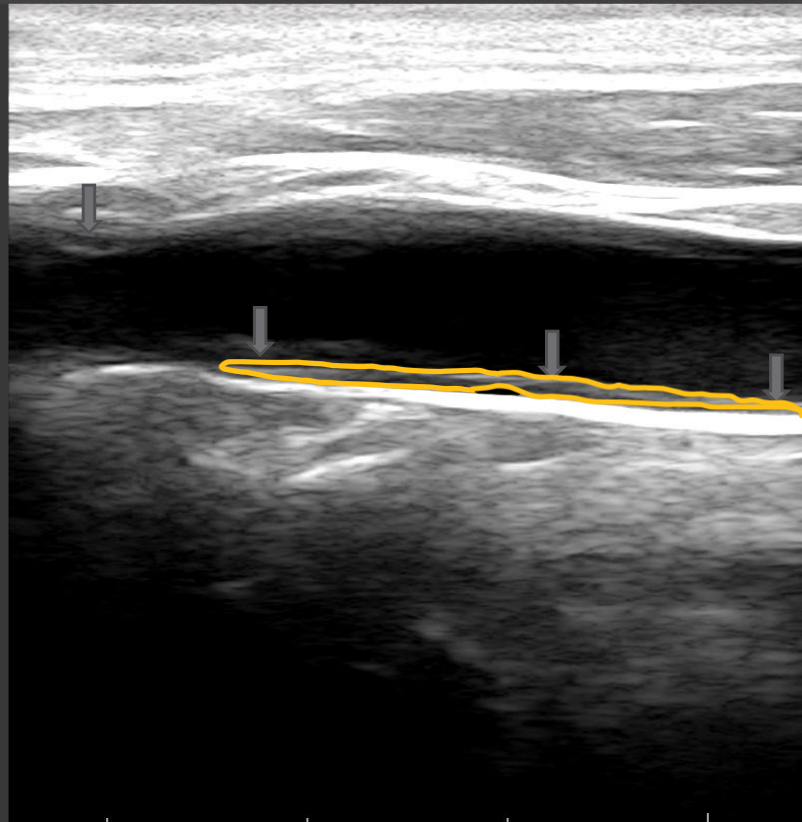

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

18.05.2016
3.5.0

08:55:34

MCC

0

2

40



[B]
FPS 19
De 40 mm
DR 72 dB
Pw0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Reg 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

18.05.2016
3.5.0


08:55:34

MCC

0

2

40

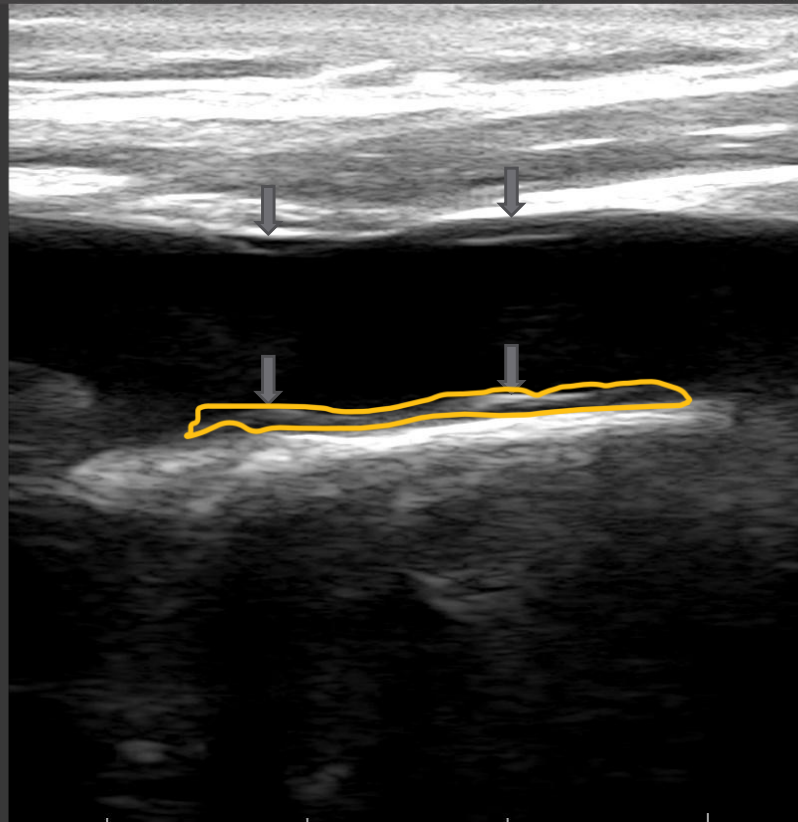

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %




VARIFO
Vascular

Sonographer: -
L12-5L40S-3

20.05.2016
3.5.0

MCC

10:05:02

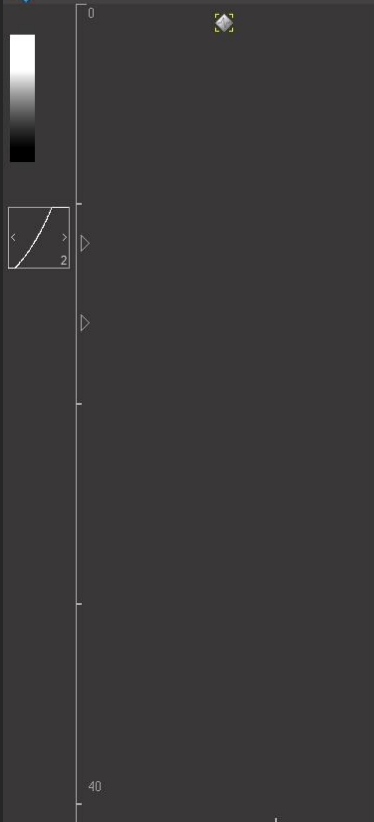

[B]
FPS 18
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %





VARIFO
Vascular

Sonographer: -
L12-5L40S-3

04.05.2016
3.5.0

MCC

09.02.53

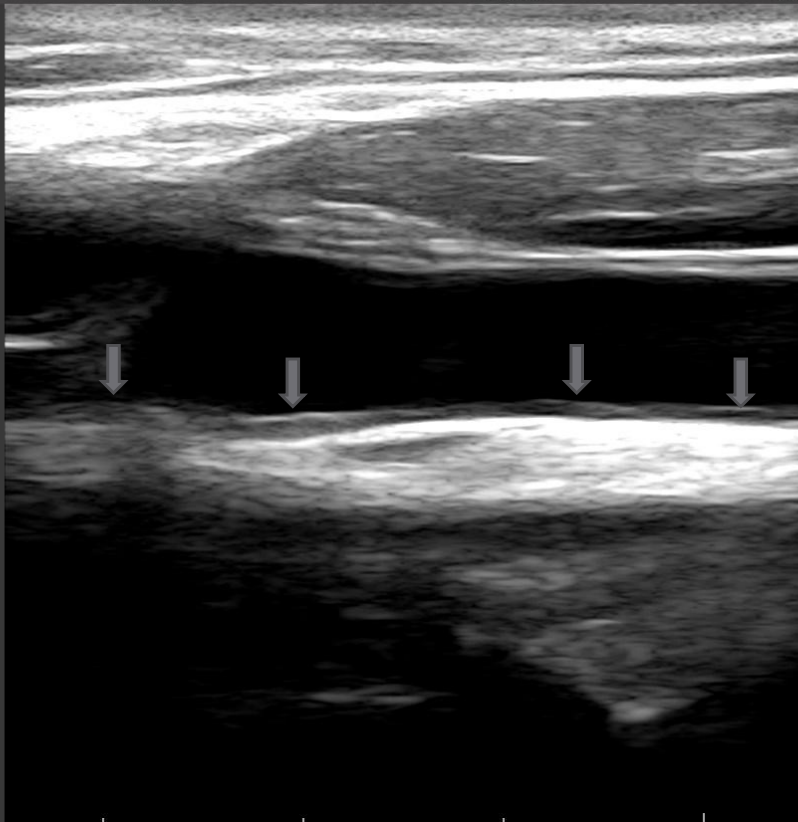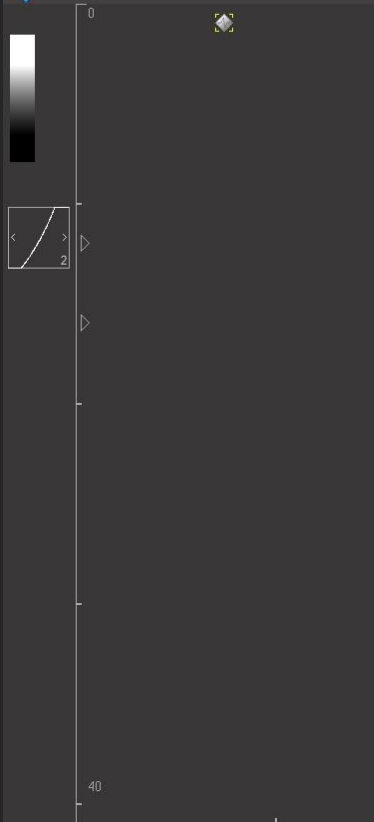

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %





VARIFO
Vascular

Sonographer: -
L12-5L40S-3

19.05.2016
3.5.0

10:02:27

MCC

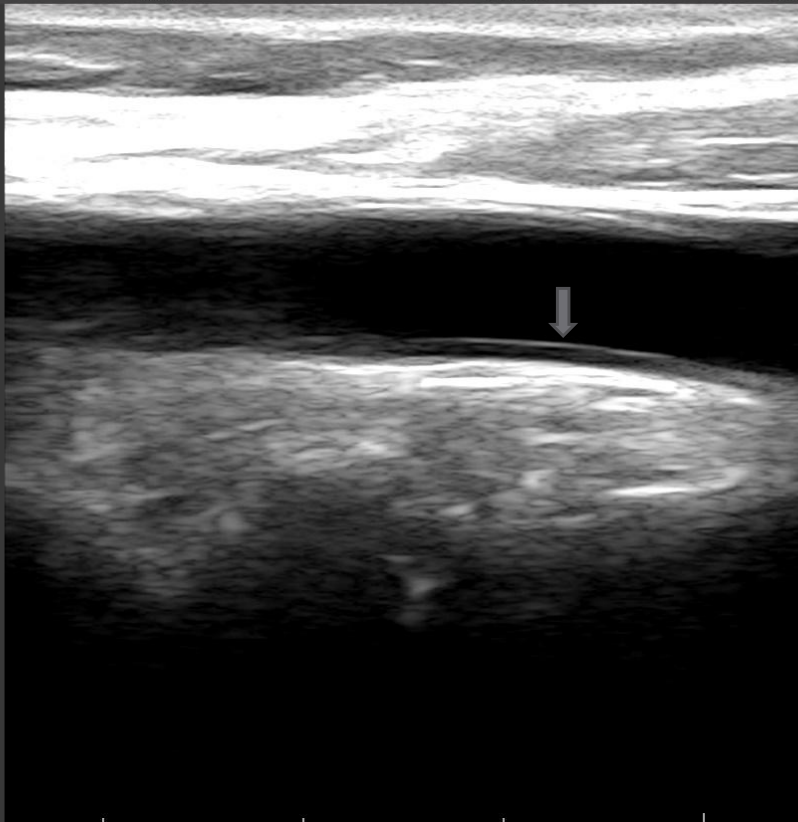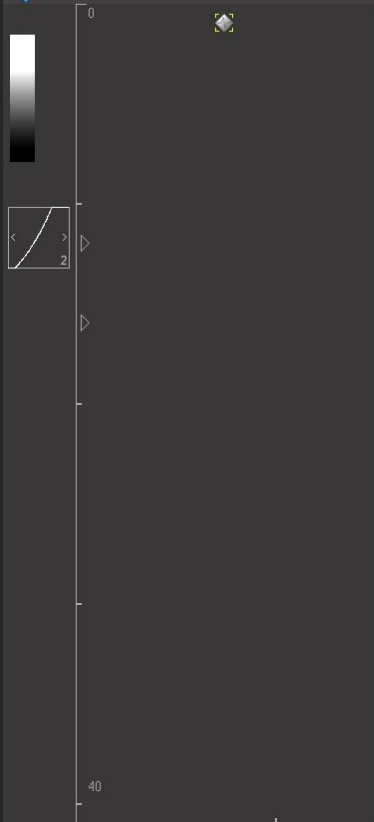

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


19.05.2016
3.5.0

10:02:27

MCC

0

40

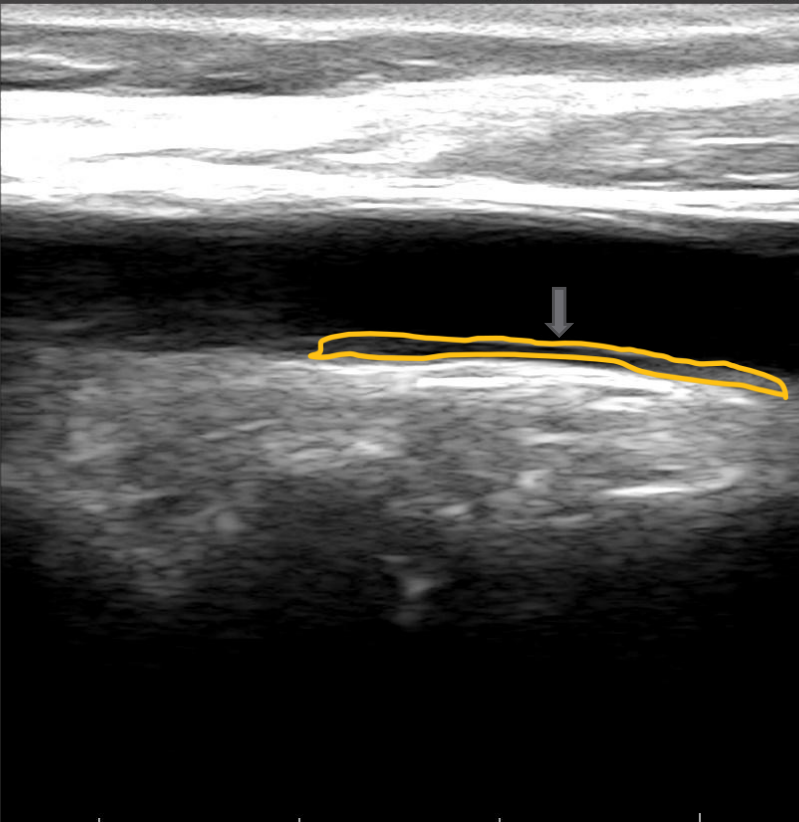

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular


Sonographer: -
L12-5L40S-3

04.05.2016
3.5.0

10:34:39

MCC

0
40

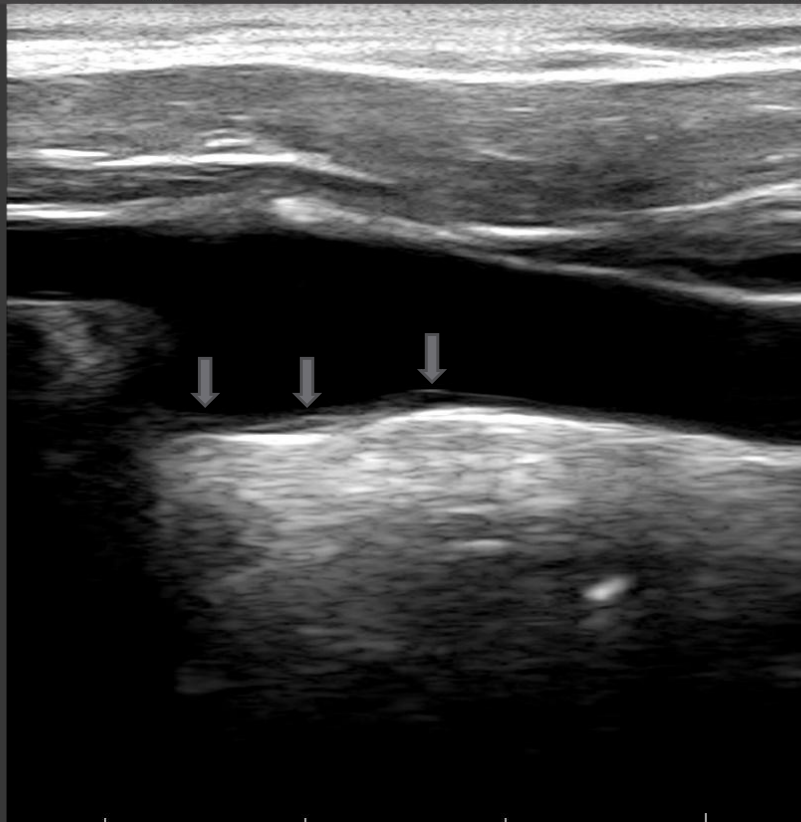

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

04.05.2016
3.5.0

MCC

10:35:10

0
40



[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


19.05.2016
3.5.0

10:02:27

MCC

0

40

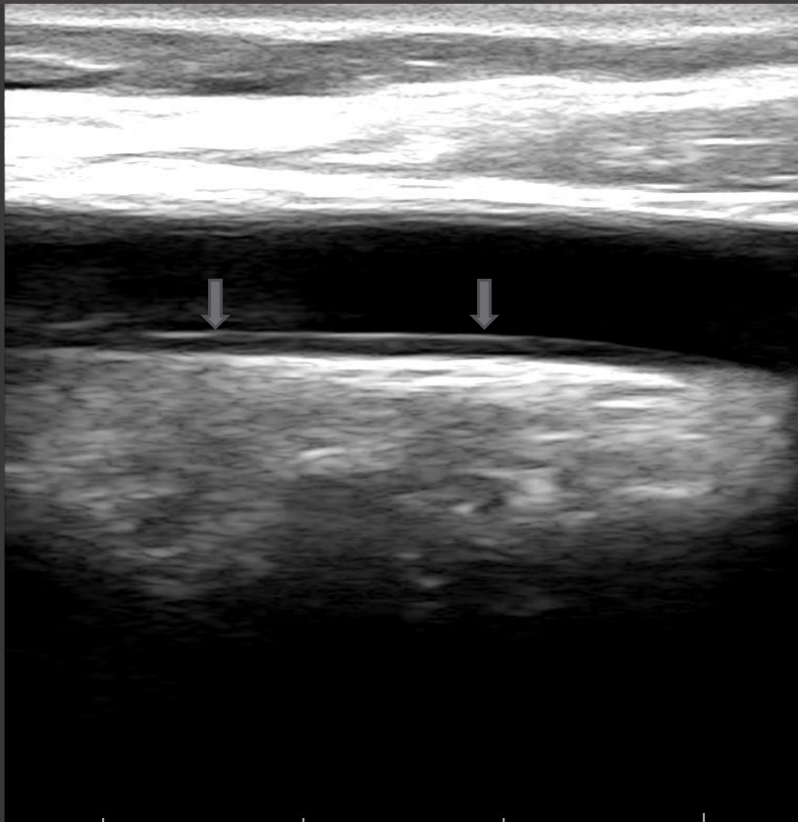

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



20.03.1938



VARIFO
Vascular

Sonographer: -
L12-5L40S-3

27.04.2016
3.5.0

15:09:46

MCC

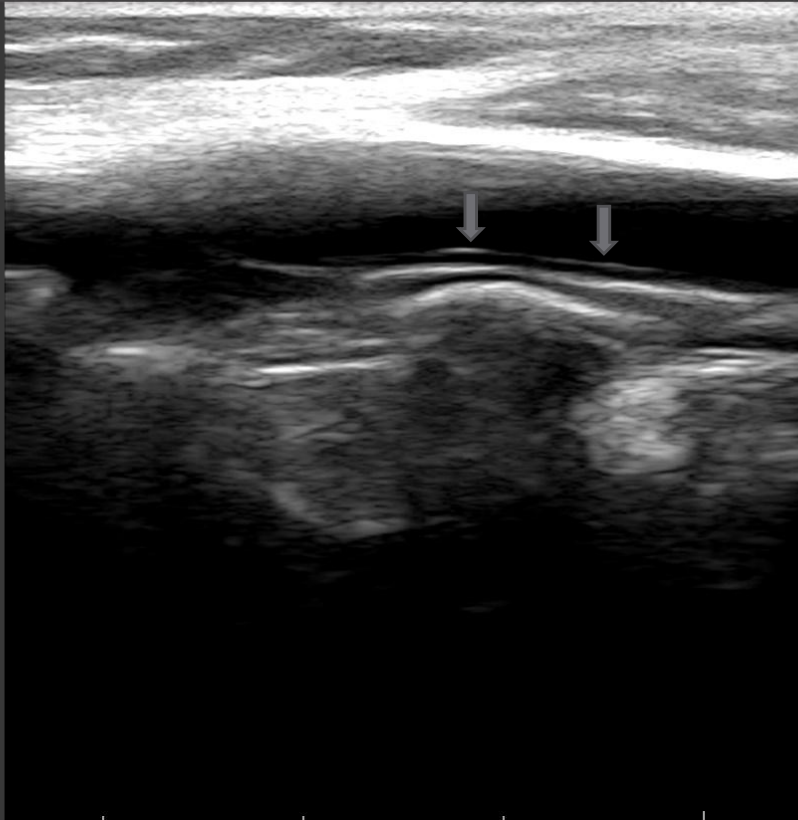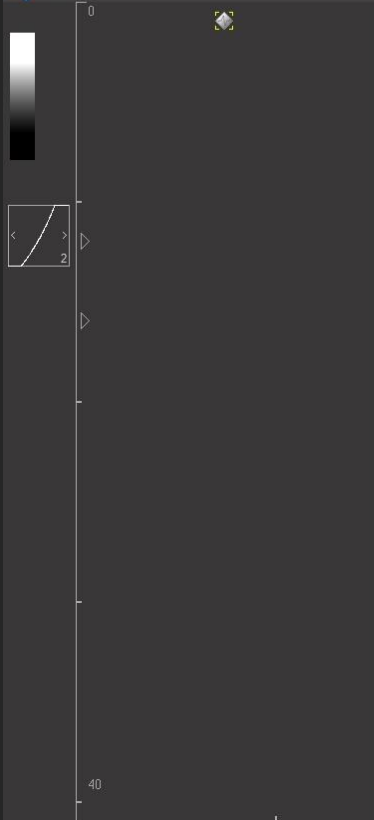

[B]
FPS 19
De 40 mm
DR 72 dB
Pwr 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %





VARIFO
Vascular

Sonographer: -
L12-5L40S-3

28.04.2016
3.5.0

MCC

09:17:00

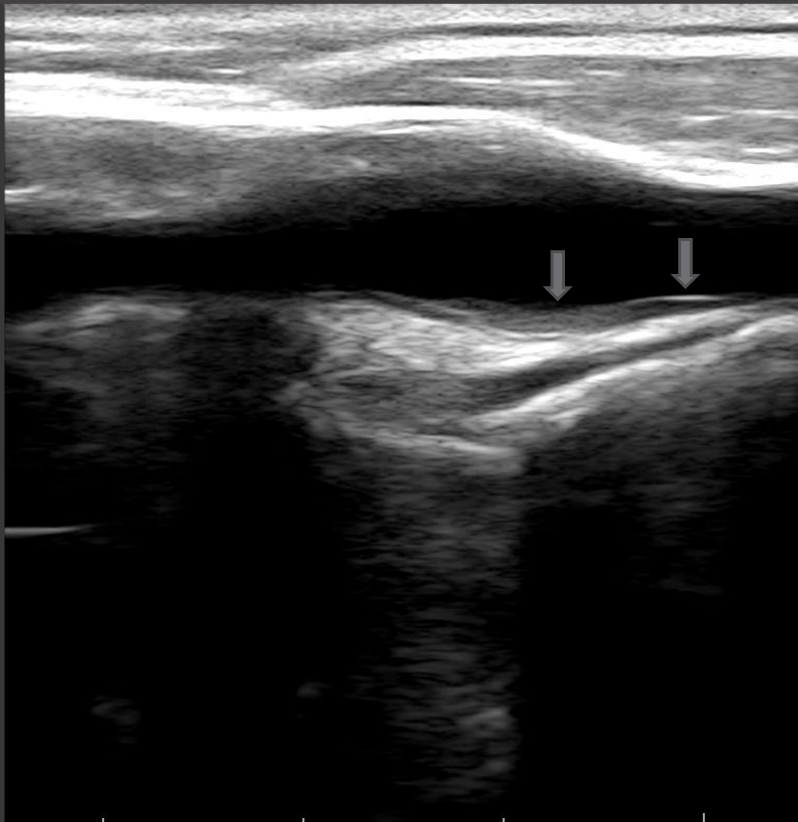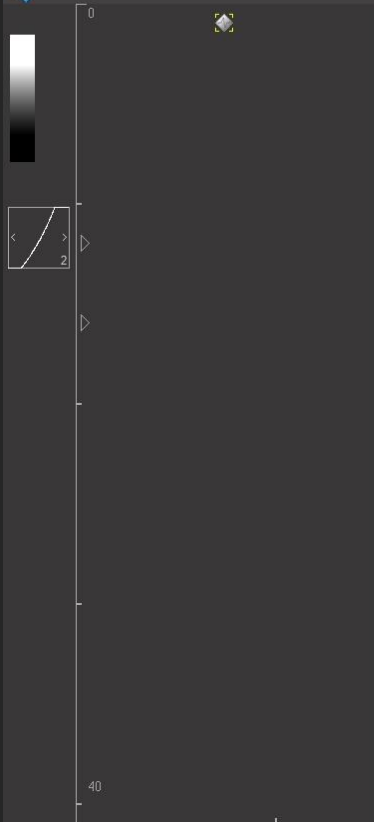

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


28.04.2016
3.5.0

MCC

09:17:00

0

40

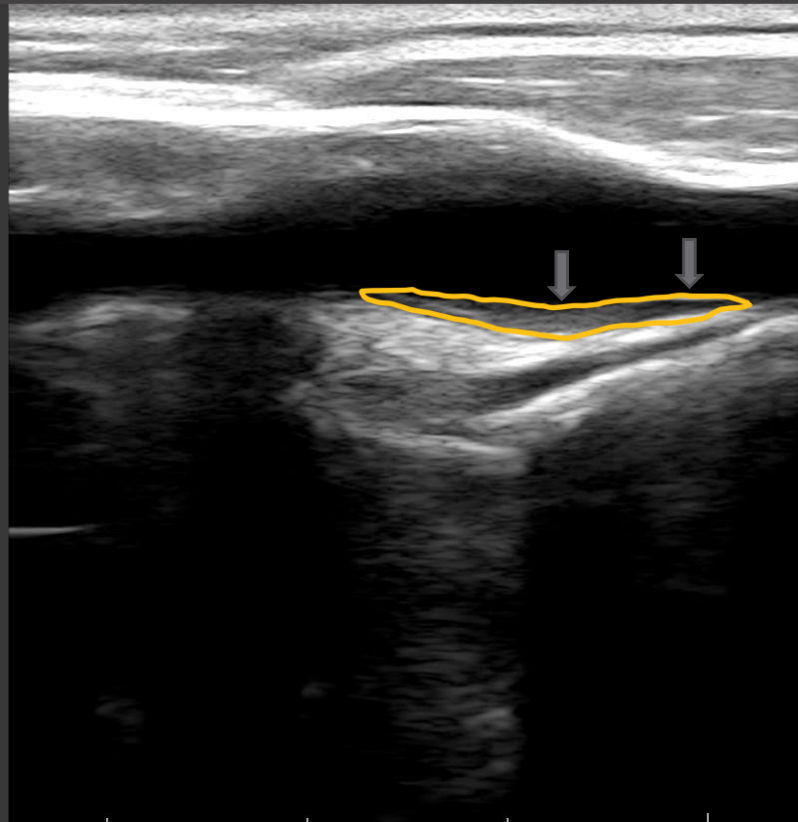

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %



VARIFO
Vascular

Sonographer: -
L12-5L40S-3


28.04.2016
3.5.0

09:17:33

MCC

0

40

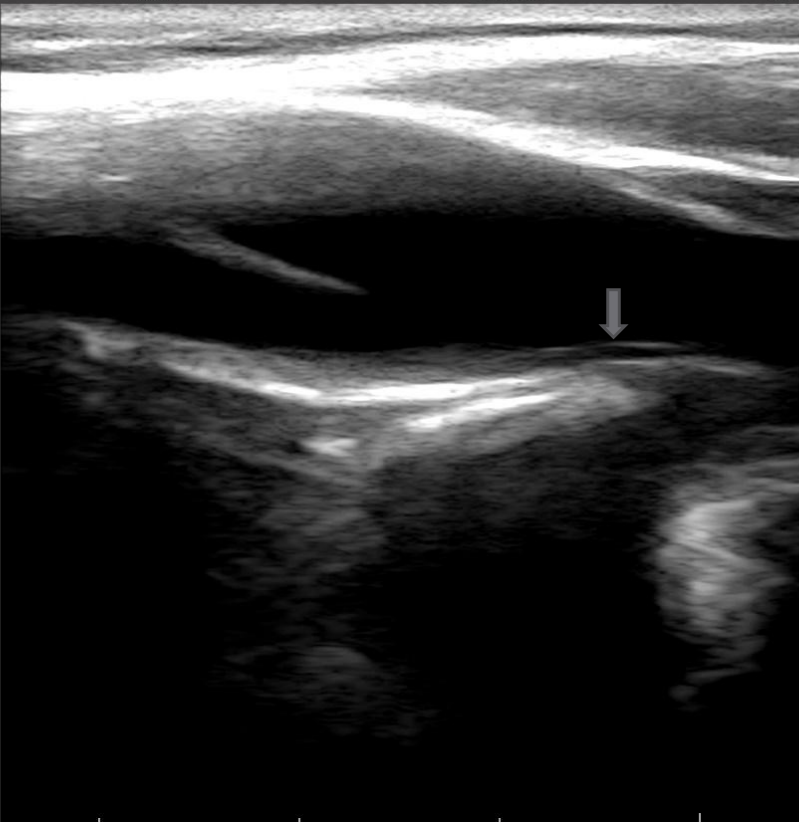

[B]
FPS 19
De 40 mm
DR 72 dB
Pw 0 dB
Gn 100 %
Frg 12 MHz
LnDens St
FrmAvg 4
Rej 32
ImEnh 3
PV 8
Zoom 100 %